

Change Order No. #1

Project: 800 West Water Line Project
Owner: Pleasant View City
Contractor: Allied Underground Technology

Notice to Proceed: 8/14/2023
Substantial Completion: 10/13/2023
Original Contract Price: \$477,203.14

SUMMARY OF CHANGE ORDER

Description of Change(s): extend water line replacement into north cul-de-sac of 800 West; add air/vac station at connection to existing water line; replace bid item 11 with item 109

Total Amount of Change: \$67,247.38
Change of Number of Days: 14

***Revised Contract Price:** \$544,450.52
***Revised Substantial Completion:** 10/27/2023

Attachments: Cost Breakdown, plan sheet

Recommended for Approval by Engineer

Date

Approved by Director of Public Works

Date

Approved by City Administrator

Date

Received by Contractor

Date

*APPROVED CHANGES TO DATE	(additional days)
CO #1: \$ -	-
CO #2: \$ -	-
CO #3: \$ -	-
CO #4: \$ -	-
CO #5: \$ -	-
Total Changes: \$ -	- days



Consulting Engineers

Cost Breakdown
Change Order No. #1

No.	Description	Quantity		Unit Price	Total Price
101	Furnish and install 8" C900 DR18 PVC water line	200	lf	\$ 60.79	\$ 12,158.00
102	Furnish and install 8" gate valve and box	1	ea	2,841.00	2,841.00
103	Furnish and install fire hydrant unit	1	ea	9,474.00	9,474.00
104	Furnish and install 3/4" service tap	3	ea	1,048.00	3,144.00
105	Furnish and install 3/4" poly service line	100	lf	23.45	2,345.00
106	Connect new poly service line to existing meter OR connect new poly service line to existing Type K copper service line	3	ea	593.66	1,780.98
107	Remove and replace asphalt pavement (4" HMA on 12" UTBC, t-patch)	300	lf	38.31	11,493.00
108	Import trench backfill	130	ton	12.73	1,654.90
109	Untreated base course	375	ton	29.58	11,092.50
110	Raise valve box to grade with concrete collar	2	ea	395.00	790.00
111	Furnish and install air/vac station	1	ea	10,474.00	10,474.00

Total Change in Contract Price: \$ 67,247.38

Additional Time Required

Additional Time Required	14	days
--------------------------	----	------

Total Change in Contract Time: 14



Allied Underground Technology LLC

PO Box 297
Wellsville, UT 84339
Brett LaMont
435-994-0373

brett.allied@gmail.com

Proposal #2; Shallow Air Vac

This proposal may be withdrawn if not accepted within 15 days

Customer Name: Pleasant View City

Date: 8-Sep-23

Job Name: 800 West Water Line Project

Job Address: 800 Wes, Pleasant View

Attention: Dana Shuler

Phone: 801-440-7403

Work Incudes

AUT is providing this proposal for the labor and material to install a shallow air vac. The price is needed since the existing pipe at the tie in location is very shallow. The price includes the cost to excavate the area around the new pipe, install the saddle and 2" piping with insulation, bedding material, excavation to area behind the curb, excavate area for manhole, install manhole on rock with piping and fittings and thrust block, excavate area to the side for vent pipe and vent structure, form and pour concrete vent base, install vent cover, backfill and compact, restore landscaping and clean up. Price also includes our additional cost for travel and bonding.

Does not include items that are covered in other bid items

Unit Measure	Description	Unit Price	Subtotal
1	Per each price to furnish the labor and needed material to install the shallow air vac as described above in the "Work Includes" section	\$ 10,474.00	\$ 10,474.00
			\$ -
3	Requested extra calandar days added to the contract		
Net Proposal Total			\$ 10,474.00

Notes


Terms: Payment Due upon completion. Invoices subject to 1.5% interest per month beginning 30 days following the due date. In the event it becomes necessary for Allied Underground Technology, LLC. to file suit to collect any money due, hereunder or for breach thereof, the owner agrees to pay, in addition to the amount due, all costs of enforcement including reasonable attorney's fees.

Allied Underground Technology's Website is alliedundergroundtechnology.com

Acceptance of Proposal and Contract.



The above prices, terms, specifications, and conditions are satisfactory and hereby accepted. You are authorized to perform the work as specified. I understand that Allied Underground Technology, LLC. is not liable for conditions beyond their control or Acts of God which delay completion of a specified job.

Date of Acceptance: _____ **By:** _____
Authorized Representative

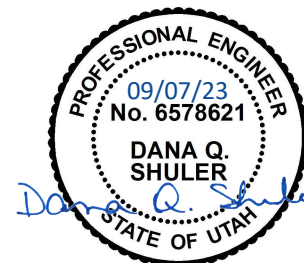


GENERAL NOTES:

- ALL SPECIFIED BRANDS OF MATERIALS SHOWN ON THESE DRAWINGS ARE "CITY STANDARDS." OTHER EQUIVALENT BRANDS MAY BE USED WITH THE PRIOR APPROVAL OF THE CITY ENGINEER AND THE CITY WATER SYSTEM SUPERINTENDENT.
- PIPES, JOINTS, FITTINGS, VALVES, & FIRE HYDRANTS SHALL CONFORM TO ANSI / NSF 61.
- ALL WATER SYSTEM MATERIALS SHALL BE NEW; USED MATERIAL ARE NOT ALLOWED.

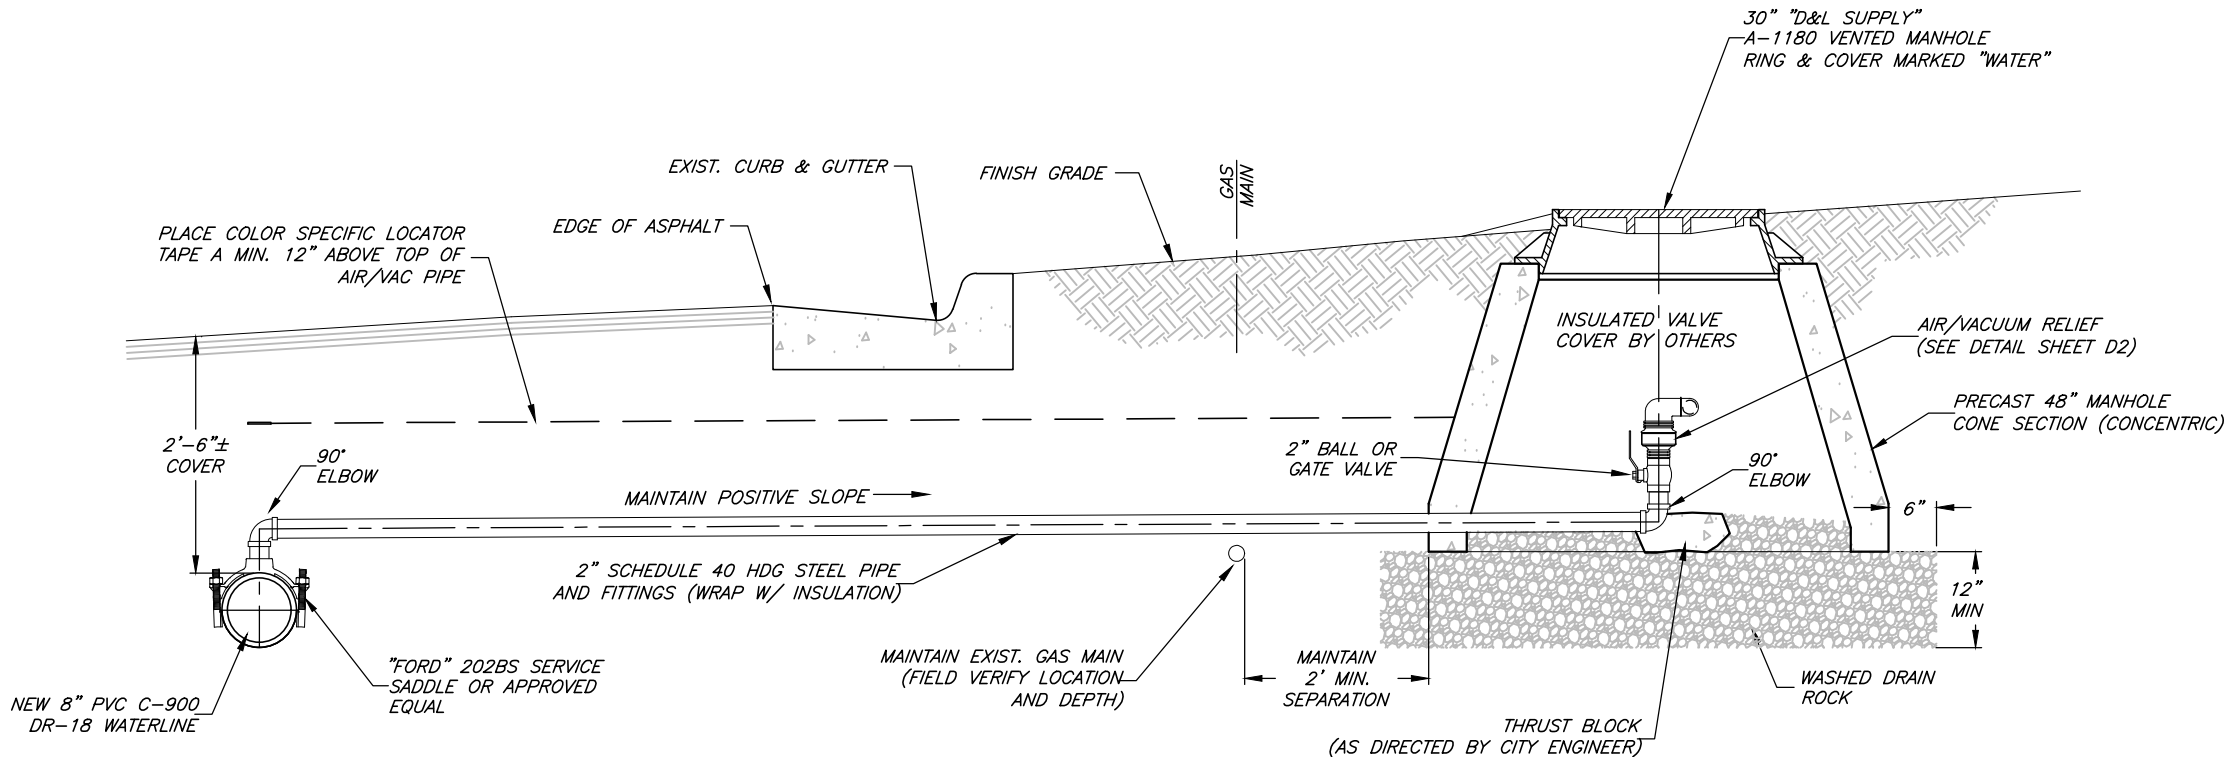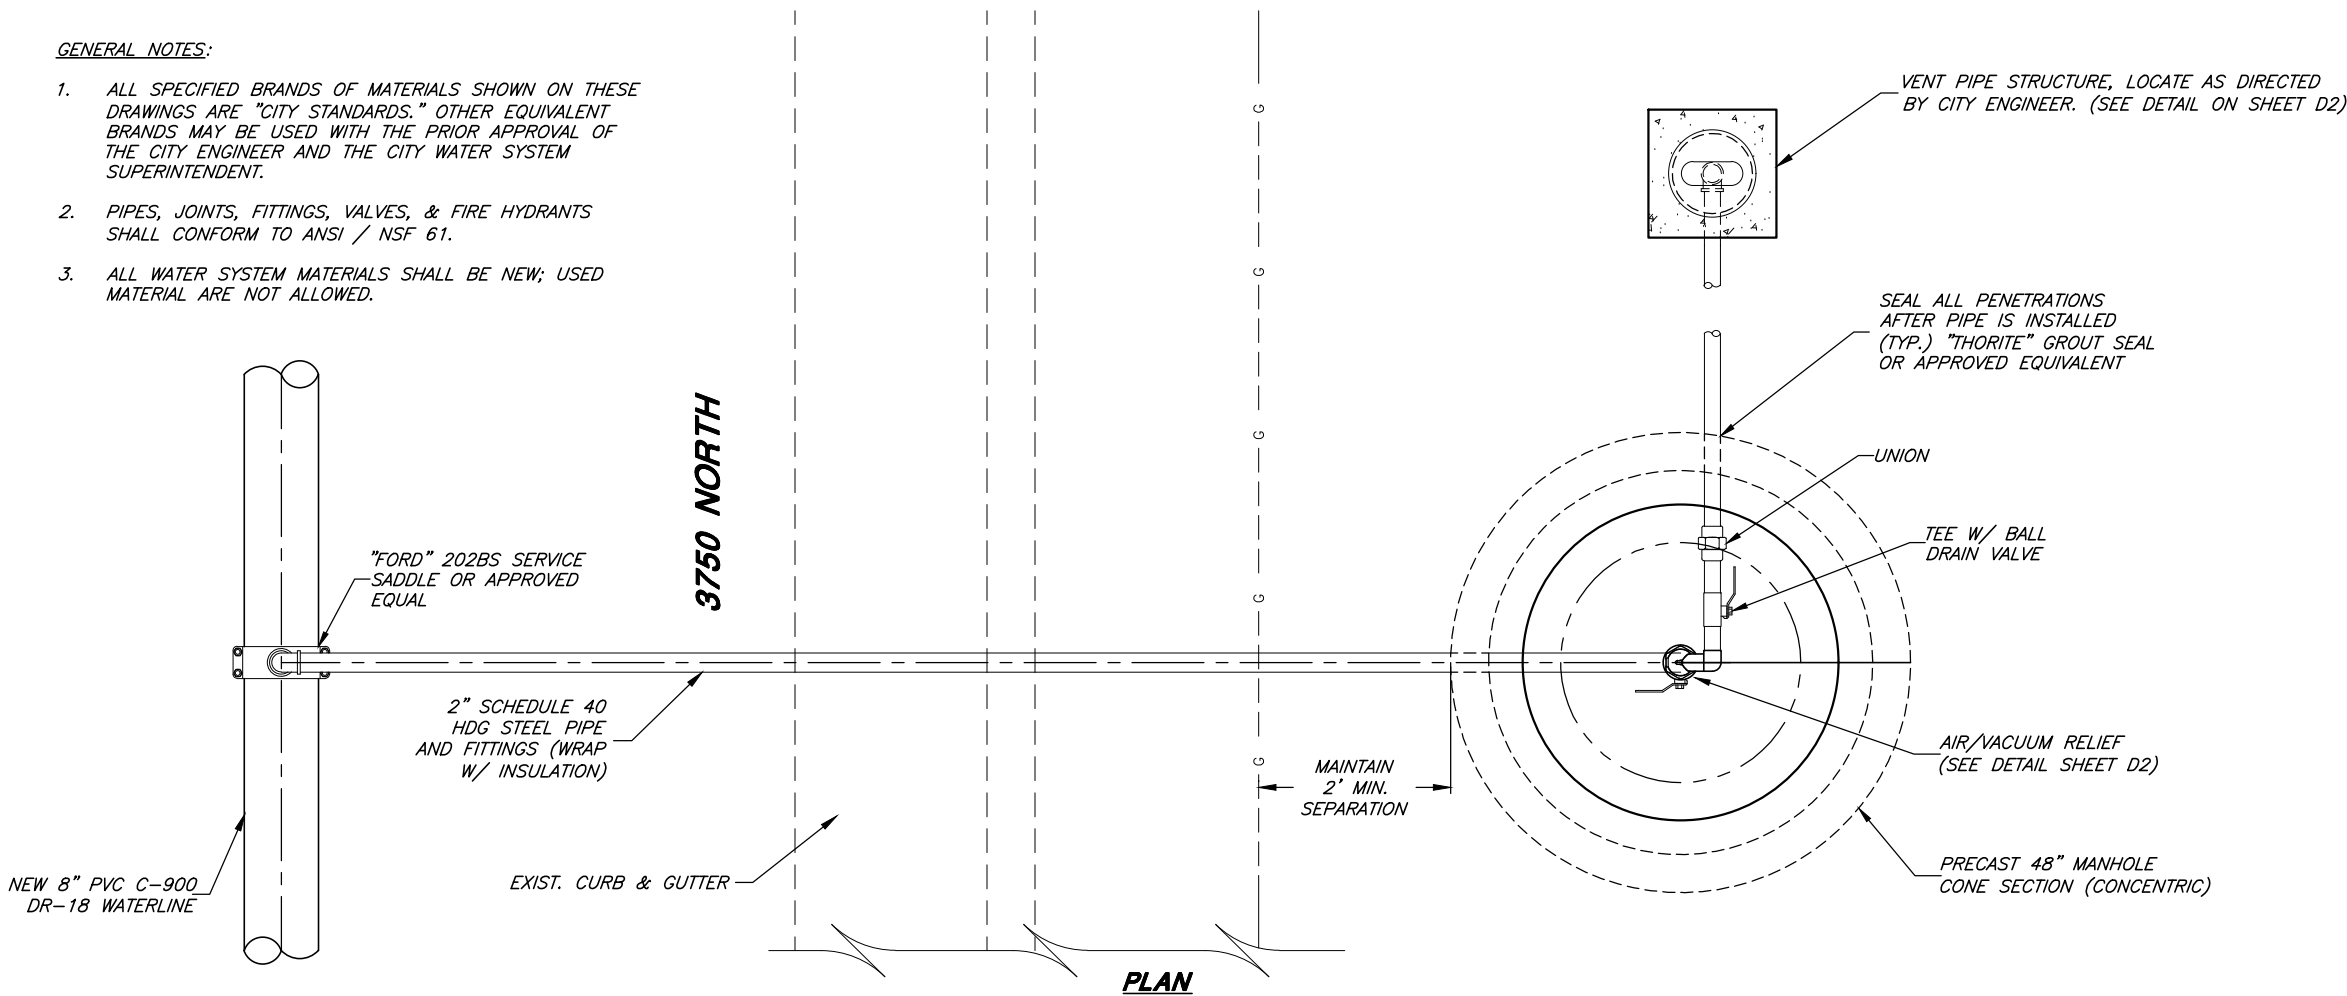

2" AIR/VACUUM RELIEF STATION



CONSULTING
ENGINEERS

JONES & ASSOCIATES

6080 Fashion Point Drive
South Ogden, Utah 84403
(801) 476-9767 www.jonescivil.com

PLEASANT VIEW CITY CORPORATION

800 WEST WATER LINE PROJECT

3750 NORTH
AIR/VACUUM RELIEF STATION

DESIGNED	DRAWN	CHECKED	APPR.
BEB	BEB	DQS	
SCALE: 24"x36" N.T.S.	11"x17" N.T.S.		

SHEET:
D1
OF 1 SHEETS