


Chart Area

## Monthly Water Usage

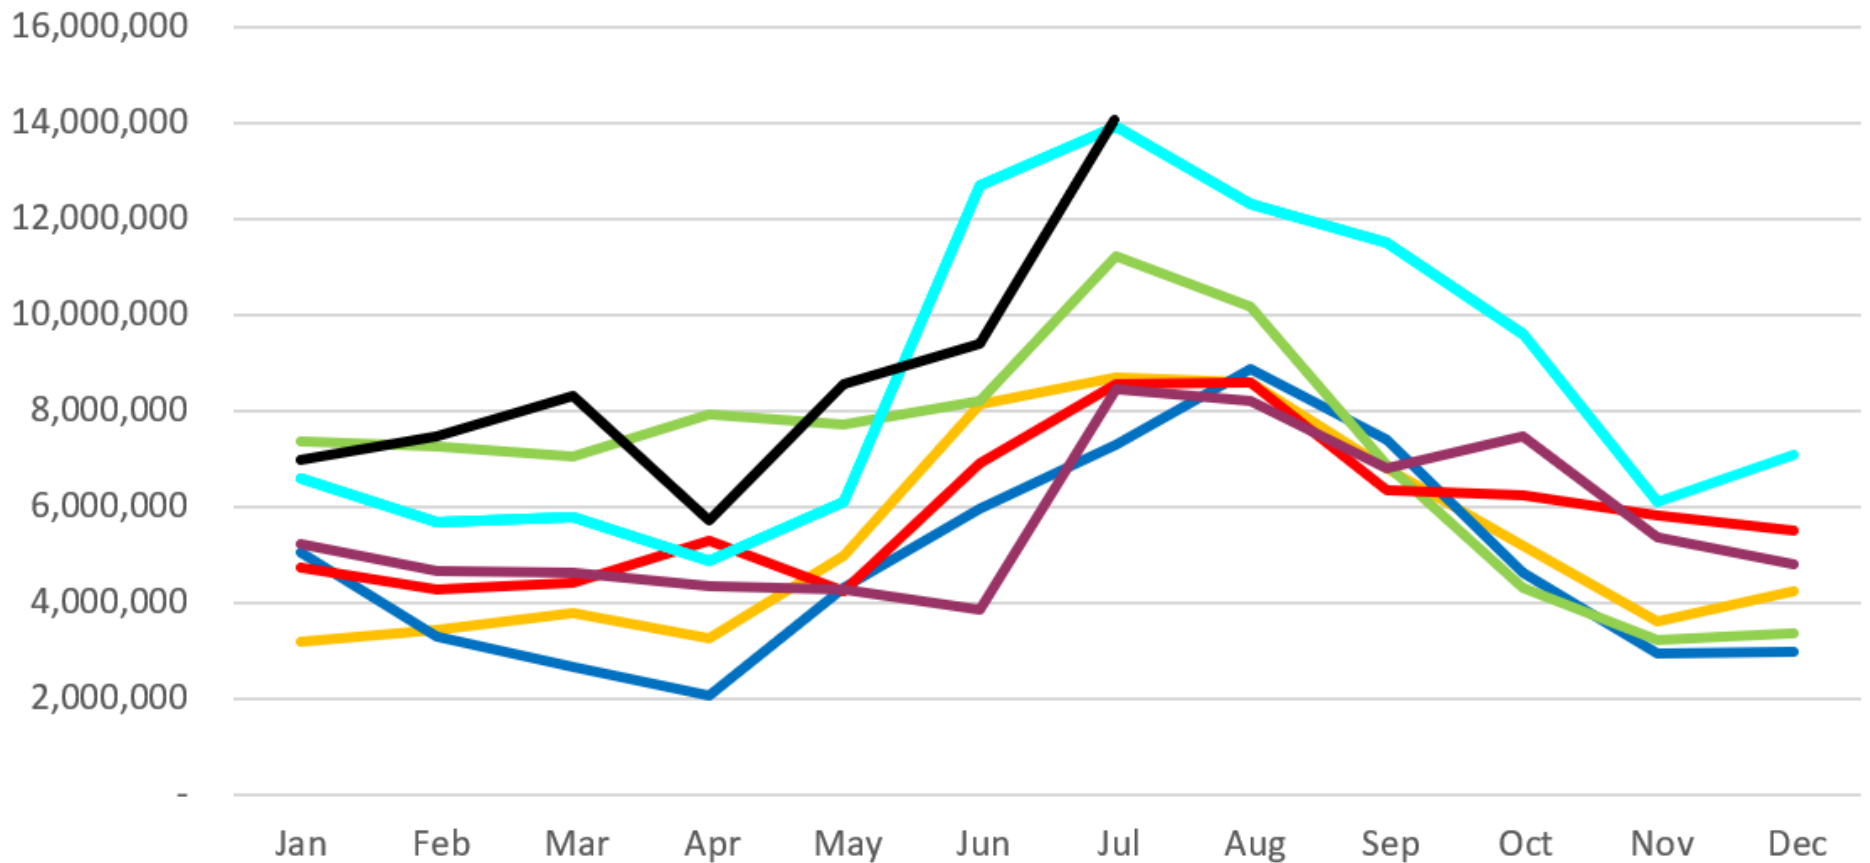

2025 - Black


2024 - Light Blue    2023 - Purple

2022 - Red    2021 - Yellow

2020 - Blue    2019 - Green

July 2025


Source Total: 14,072,734 Gallons

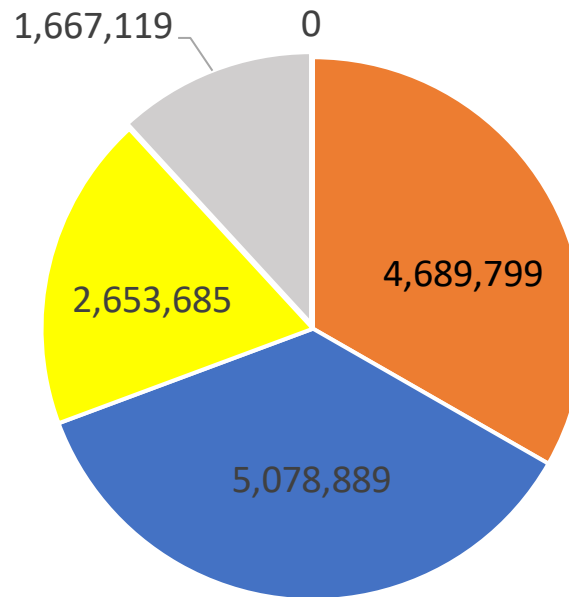

- District Metered Usage
- Conveyed Water Usage
- Unaccounted Stewart Zone
- Unaccounted Lower Pressure zone
- Unaccounted Upper Pressure Zone

April 2023 To Present

C  
F  
S

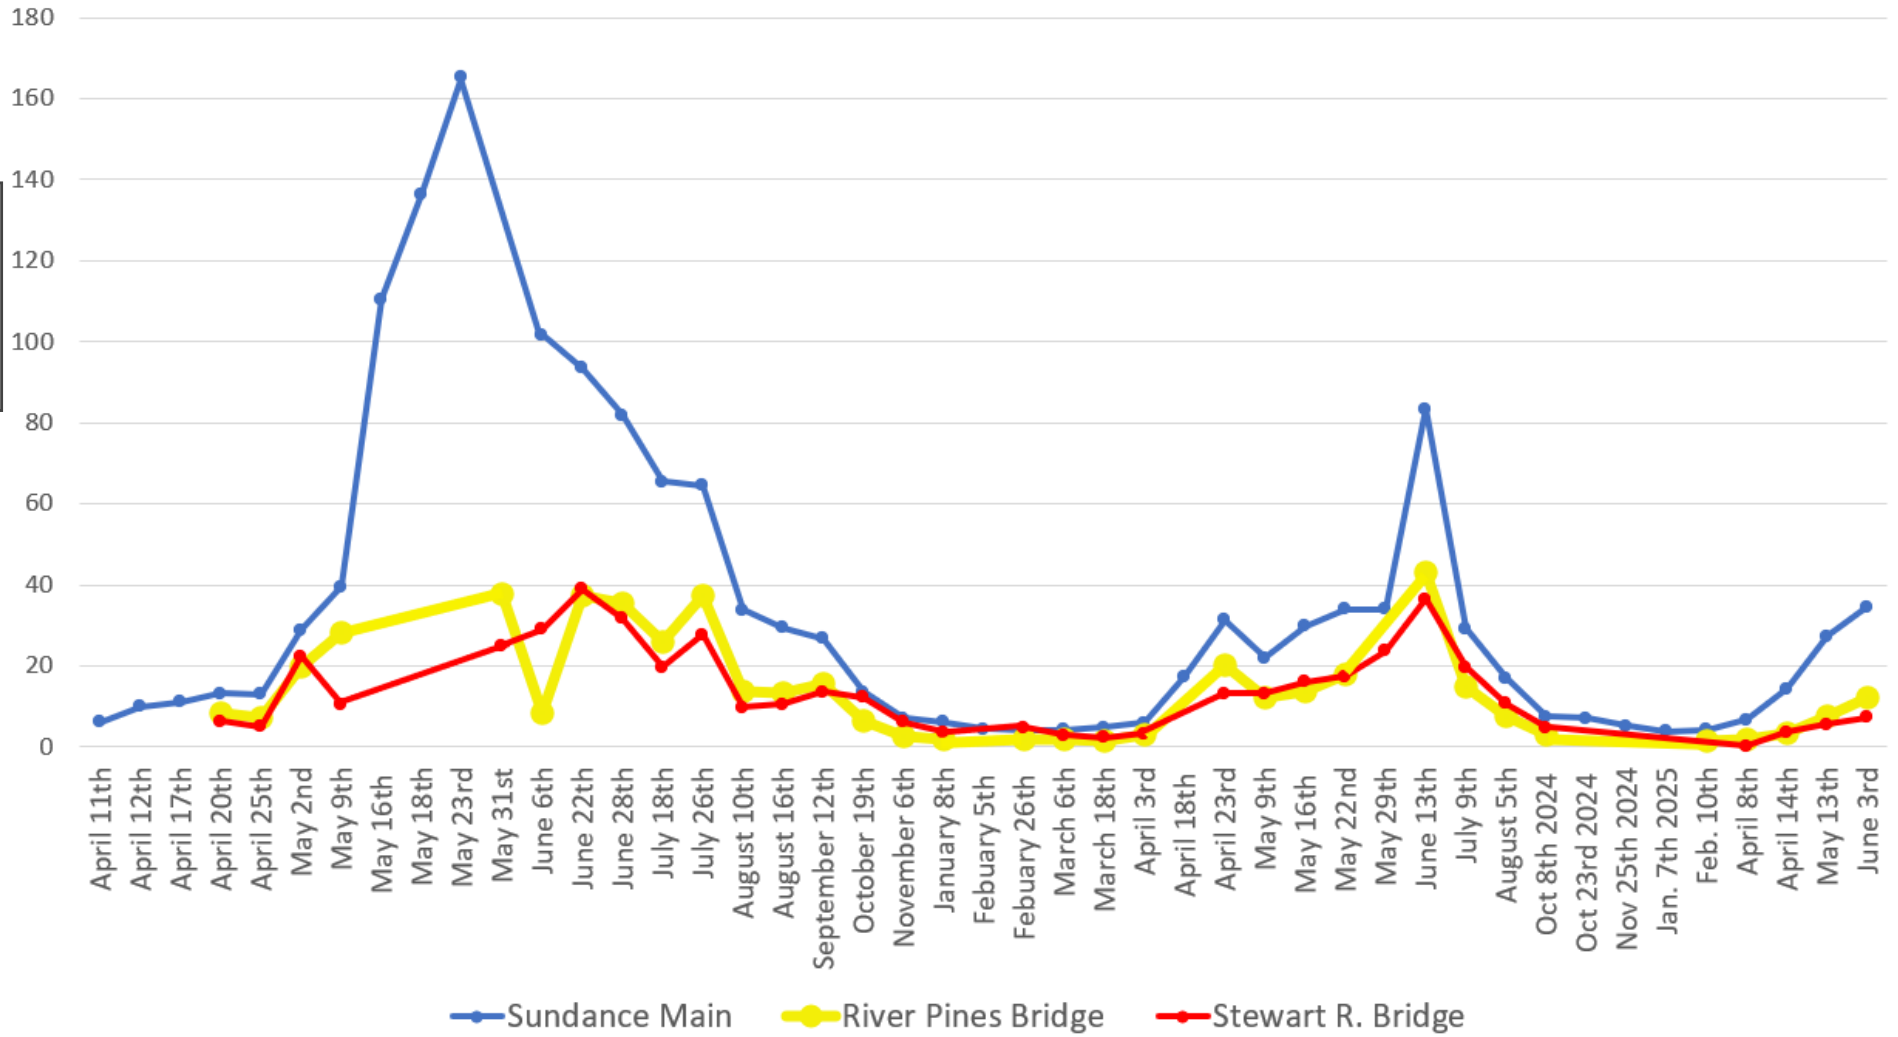


## **Water Department Information for July**

- Our overall water consumption is lower than last year but higher than the prior years.
- Aspen Grove wet-well levels are averaging 8.0 feet for July 2025 which is slightly down from last month. This time last year, in July 2024, our average was 8.7 feet.
- Stewart Spring is averaging 115 gpm for July 2025, which is same as last month. This time last year it was averaging 112 gpm for July 2024.
- Stewart spring overflow is running 17 gpm for the month of July which is down from last month. Total, Stewart Spring produced an average of 132 gpm for July.
- Unaccounted water
  - Upper Pressure Zone
    - Still at zero.
  - Lower Pressure Zone and Stewart Zone
    - Unaccounted water is back up to 30% all together.
- We have replaced 237 meters so far as of July 10<sup>th</sup>, 2024. And 218 meters are on cellular endpoints now. We only have a few meters left.
- We are trying to locate the last meters. We may have to hire a company to do an concrete Xray.
- Aqua Engineering is working on the design of the Drinking water treatment facility. COP has applied to a building permit. We are working on an easement for the building and pipeline.
- Aqua is working on master meters and updating the master plan.


## **Wastewater Department Information for July**

- We have one lab for July, TSS was the only one out of limits, which was the same as last month sample.
- Finalizing the asset document for the DEQ loan.
- Found a bad solenoid valve on the fine screen. Its been ordered and will be replaces next week.
- Constuction:
  - Working on the concrete walls.
  - The retaining wall is done.

Wastewater Labs Chart 2024

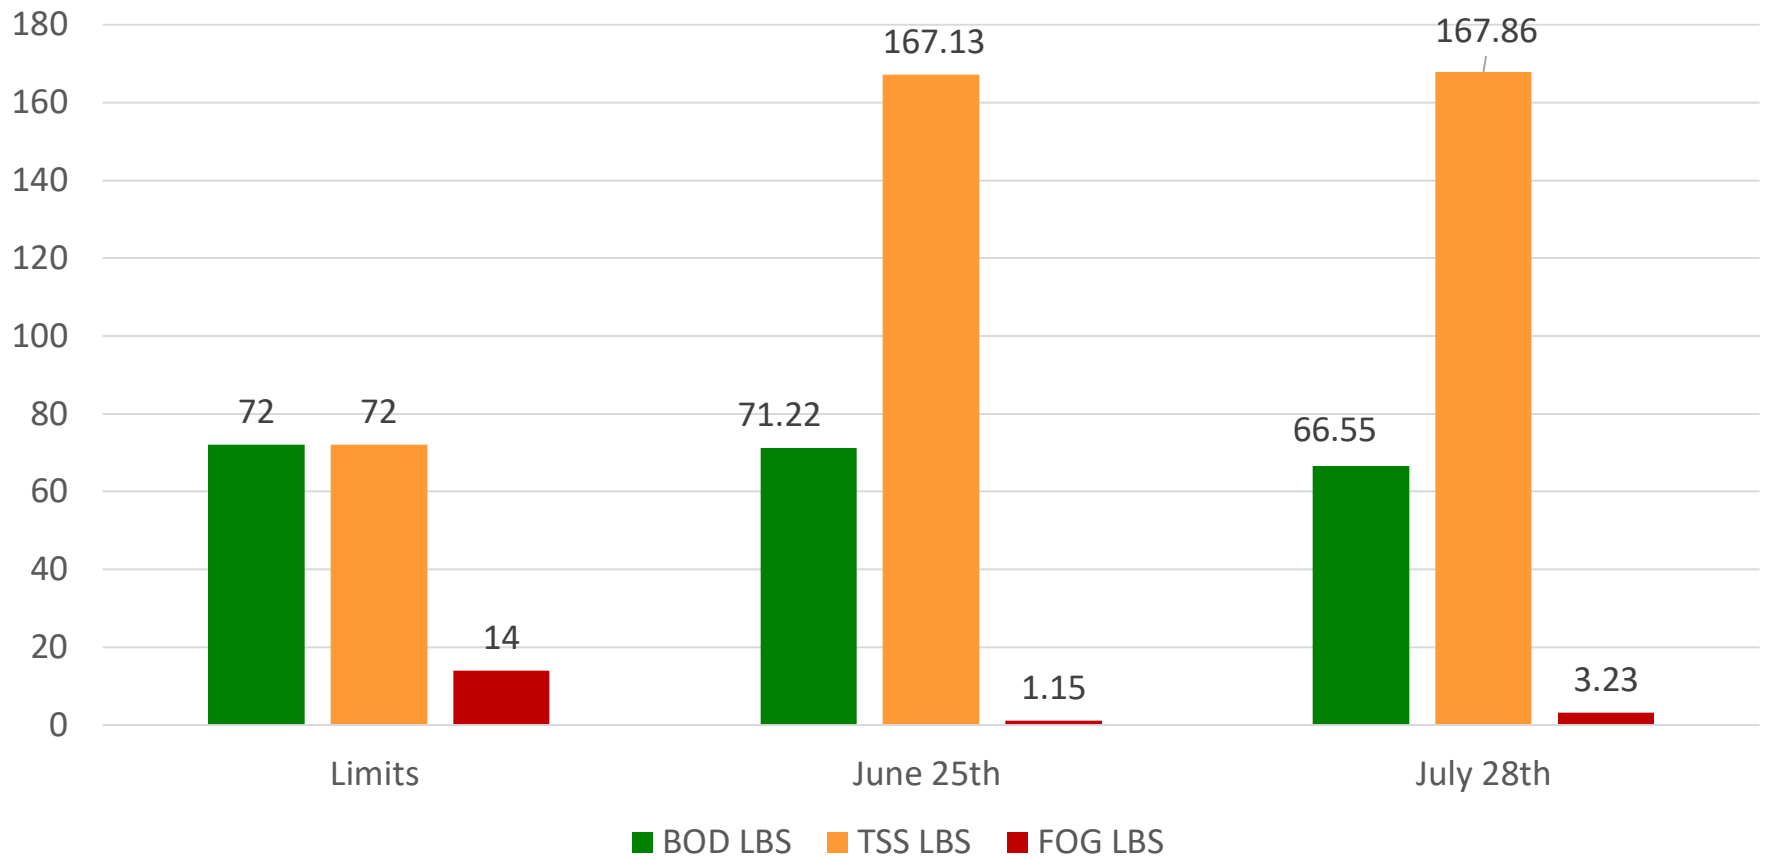

# Current Month: 2025

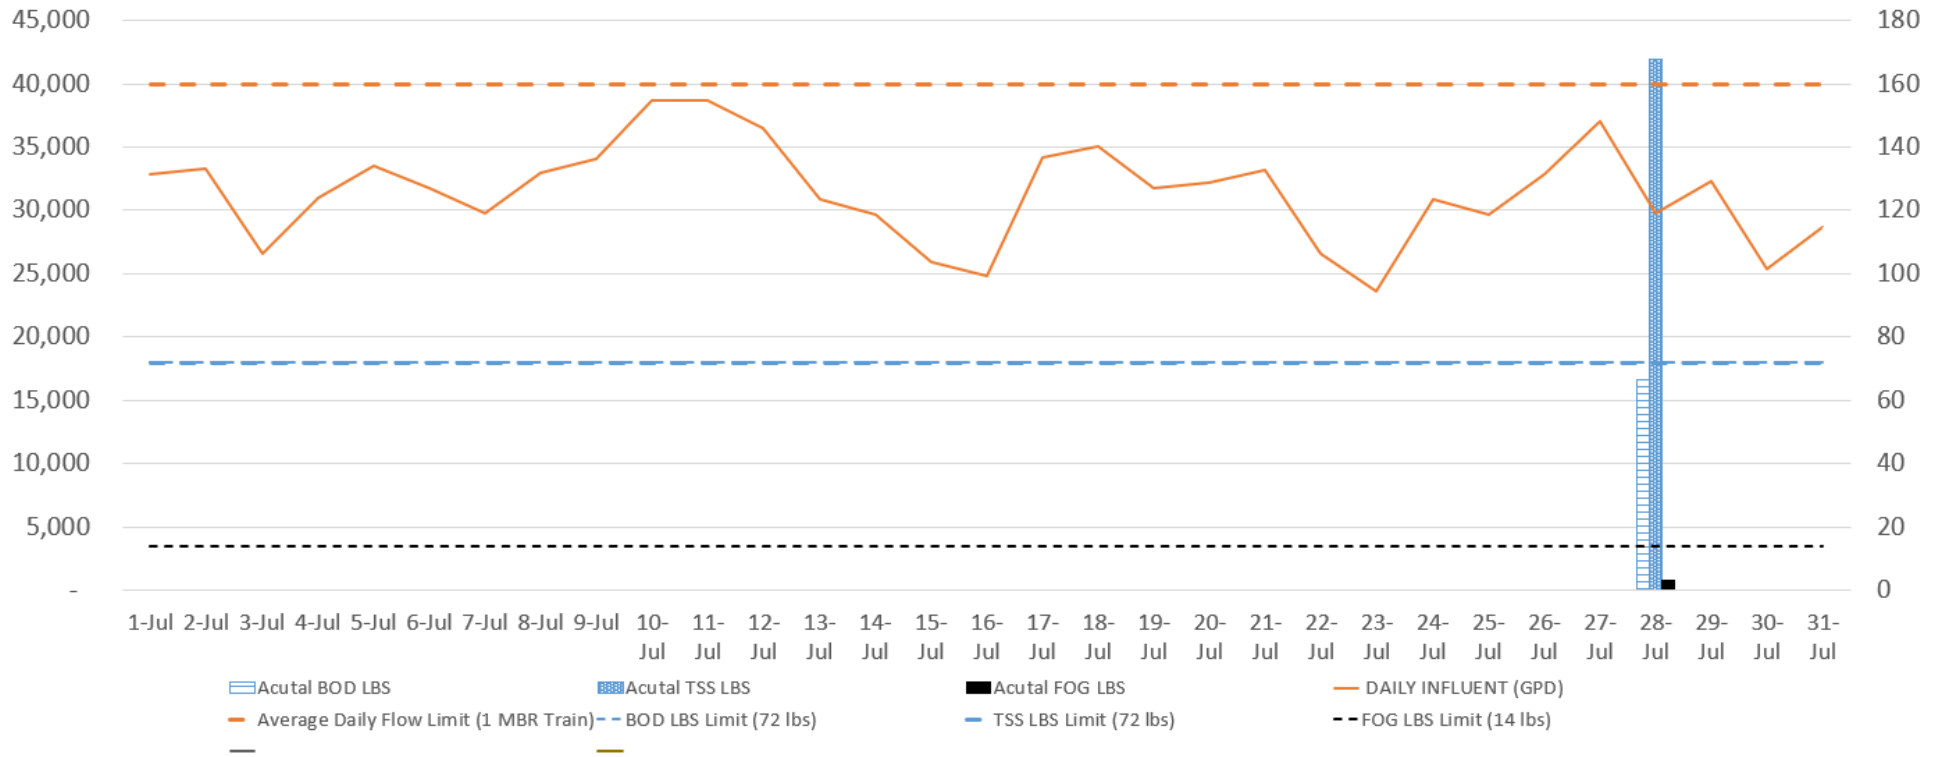

AVERAGE DAILY FLOW (GPD)	31,424
HIGHEST DAILY FLOW (GPD)	38,725

