
Monthly Water Usage

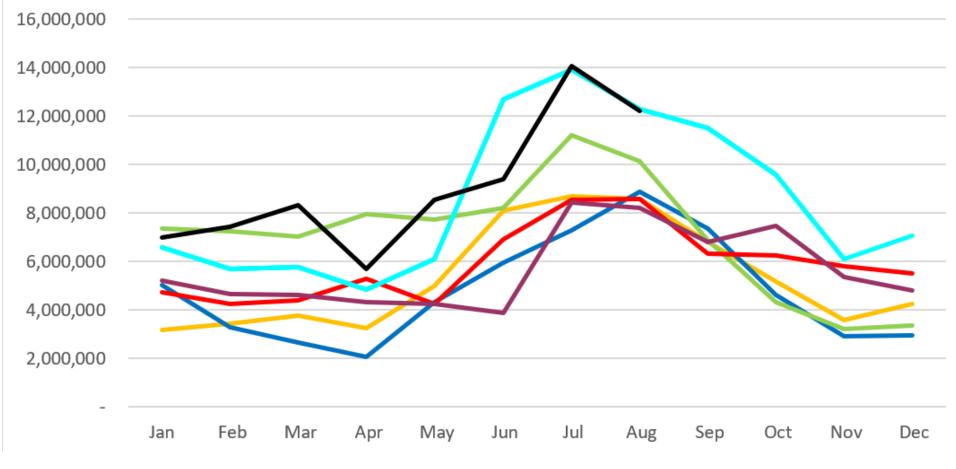


2025 - Black

2024 – Light Blue 2023 – Purple


2022 – Red 2021 – Yellow

2020 - Blue 2019 - Green

August 2025

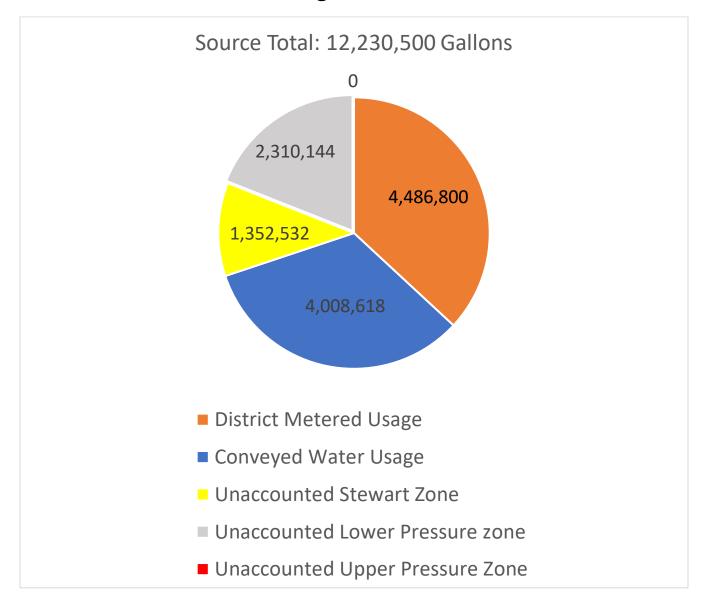

29.95% Total Unaccounted Water

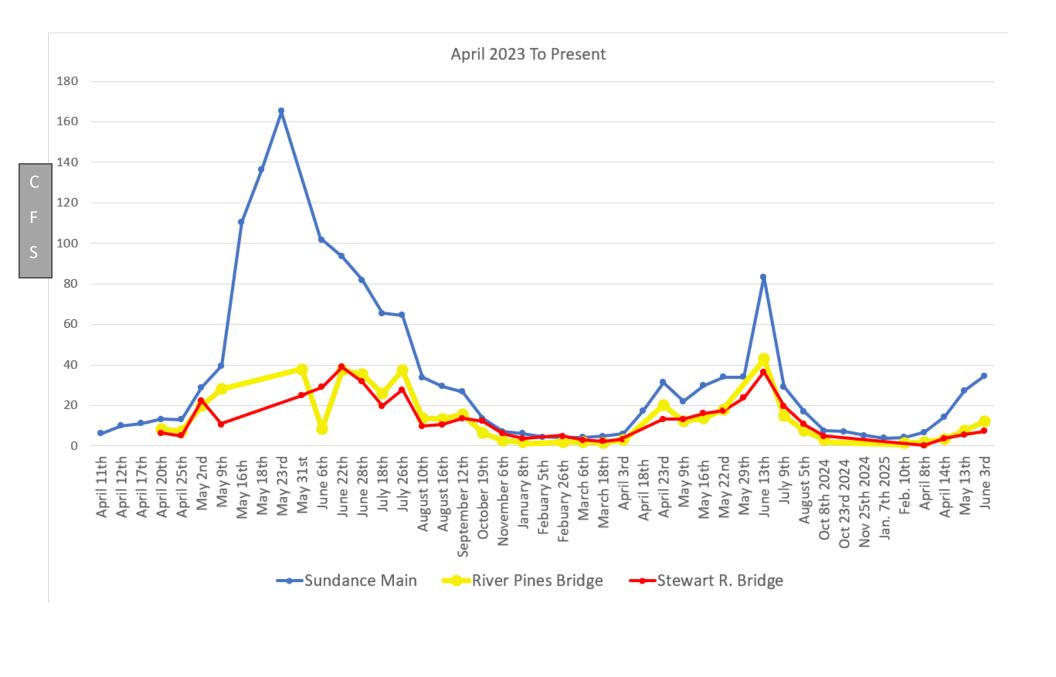



Water Department Information for August

- Our overall water consumption is same as last year but higher than the prior years.
- Aspen Grove wet-well levels are averaging 7.3 feet for August 2025 which is slightly down from last month. This time last year, in August 2024, our average was 8.3 feet.
- Stewart Spring is averaging 104 gpm for August 2025, which is same as last month. This time last year it was averaging 106 gpm for August 2024.
- Stewart spring overflow is running 39 gpm for the month of August which is down from last month. Total, Stewart Spring produced an average of 143 gpm for August.
- Unaccounted water
 - Upper Pressure Zone
 - Still at zero.
 - Lower Pressure Zone and Stewart Zone
 - Unaccounted water is 30% all together.
- We have replaced 239 meters so far as of August 10th, 2024. And 236 meters are on cellular endpoints now. We only have a few meters left.
- COP has started construction of the water treatment plant.
- Aqua is working on master meters and updating the master plan.
- We had a leak detection company go over the system.
- We are raising and concreting them in.

Wastewater Department Information for August

- We have one lab for August, TSS and BOD were out of limits.
- Finalizing the asset document for the DEQ loan.
- Replaced solenoid valve on the fine screen.
- We had elevation concerns with the wwtp that we are working though.
- We had to replace two DC power converters.
- The roof should be completed this week
- The tank is filled and we have a few small leaks to fix.

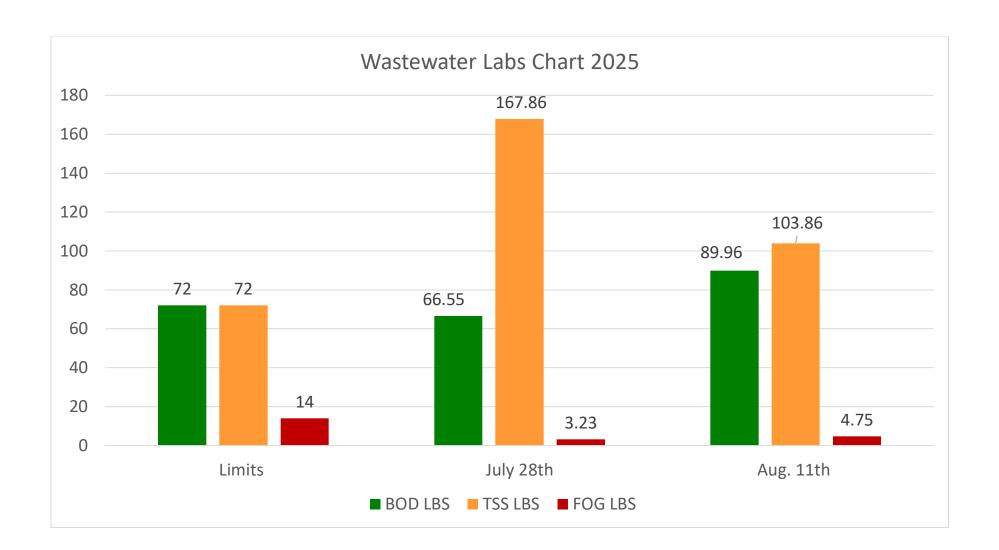

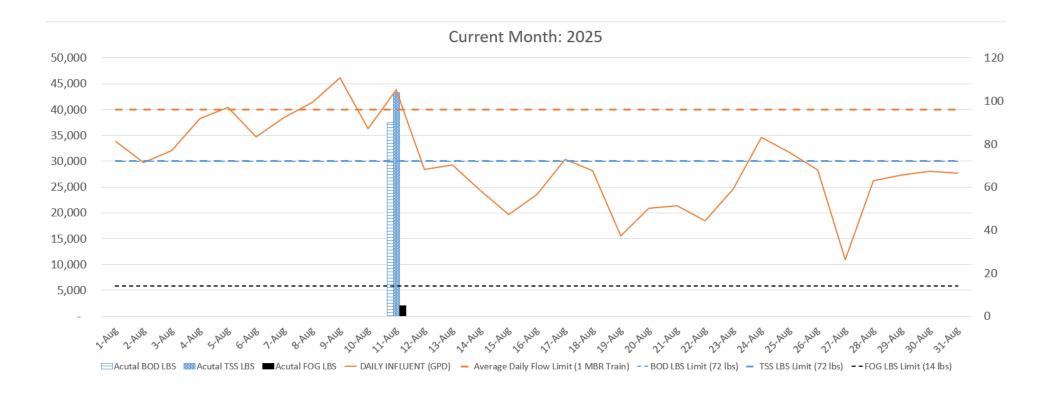

AVERAGE DAILY FLOW (GPD) 29,487 HIGHEST DAILY FLOW (GPD) 46,066

