


Monthly Water Usage

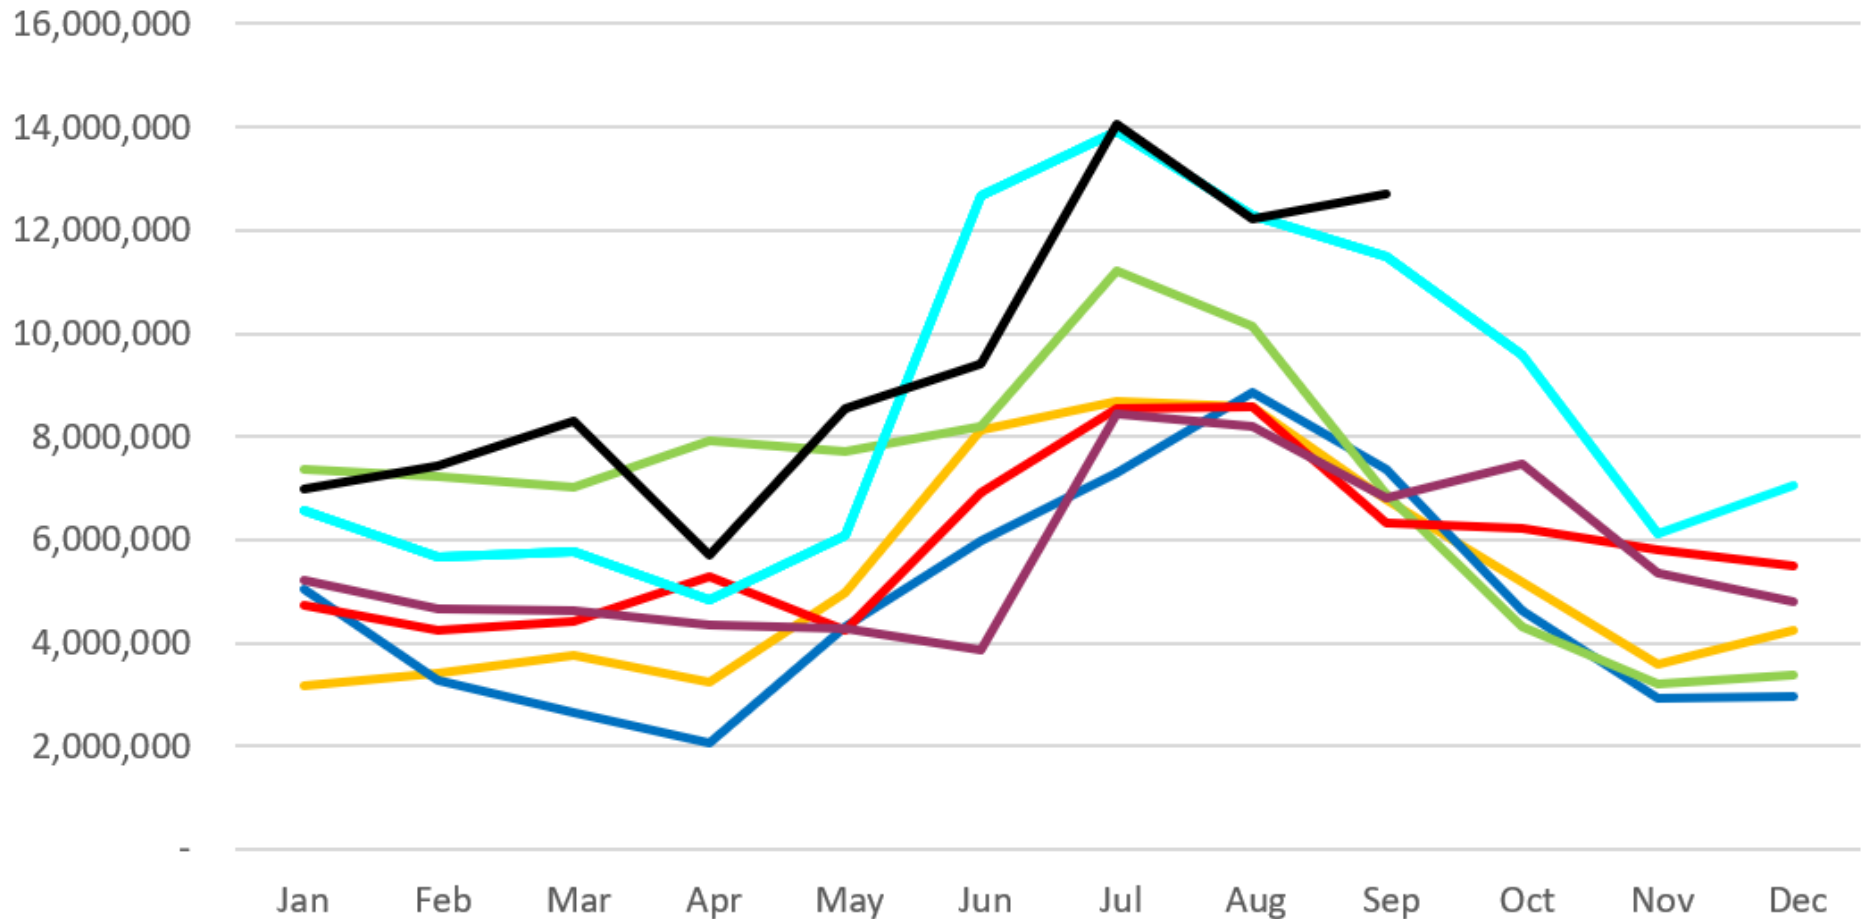

2025 - Black


2024 - Light Blue 2023 - Purple

2022 - Red 2021 - Yellow

2020 - Blue 2019 - Green

September 2025

Source Total: 12,691,164 Gallons

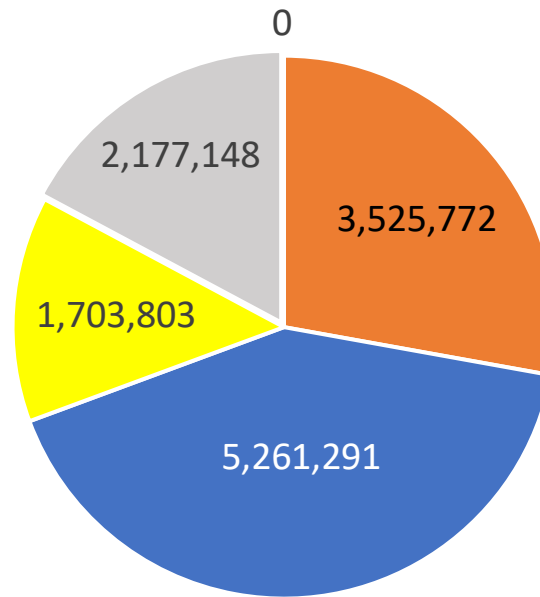


- District Metered Usage
- Conveyed Water Usage
- Unaccounted Stewart Zone
- Unaccounted Lower Pressure zone
- Unaccounted Upper Pressure Zone

30.58% Total Unaccounted Water

April 2023 To Present

C
F
S

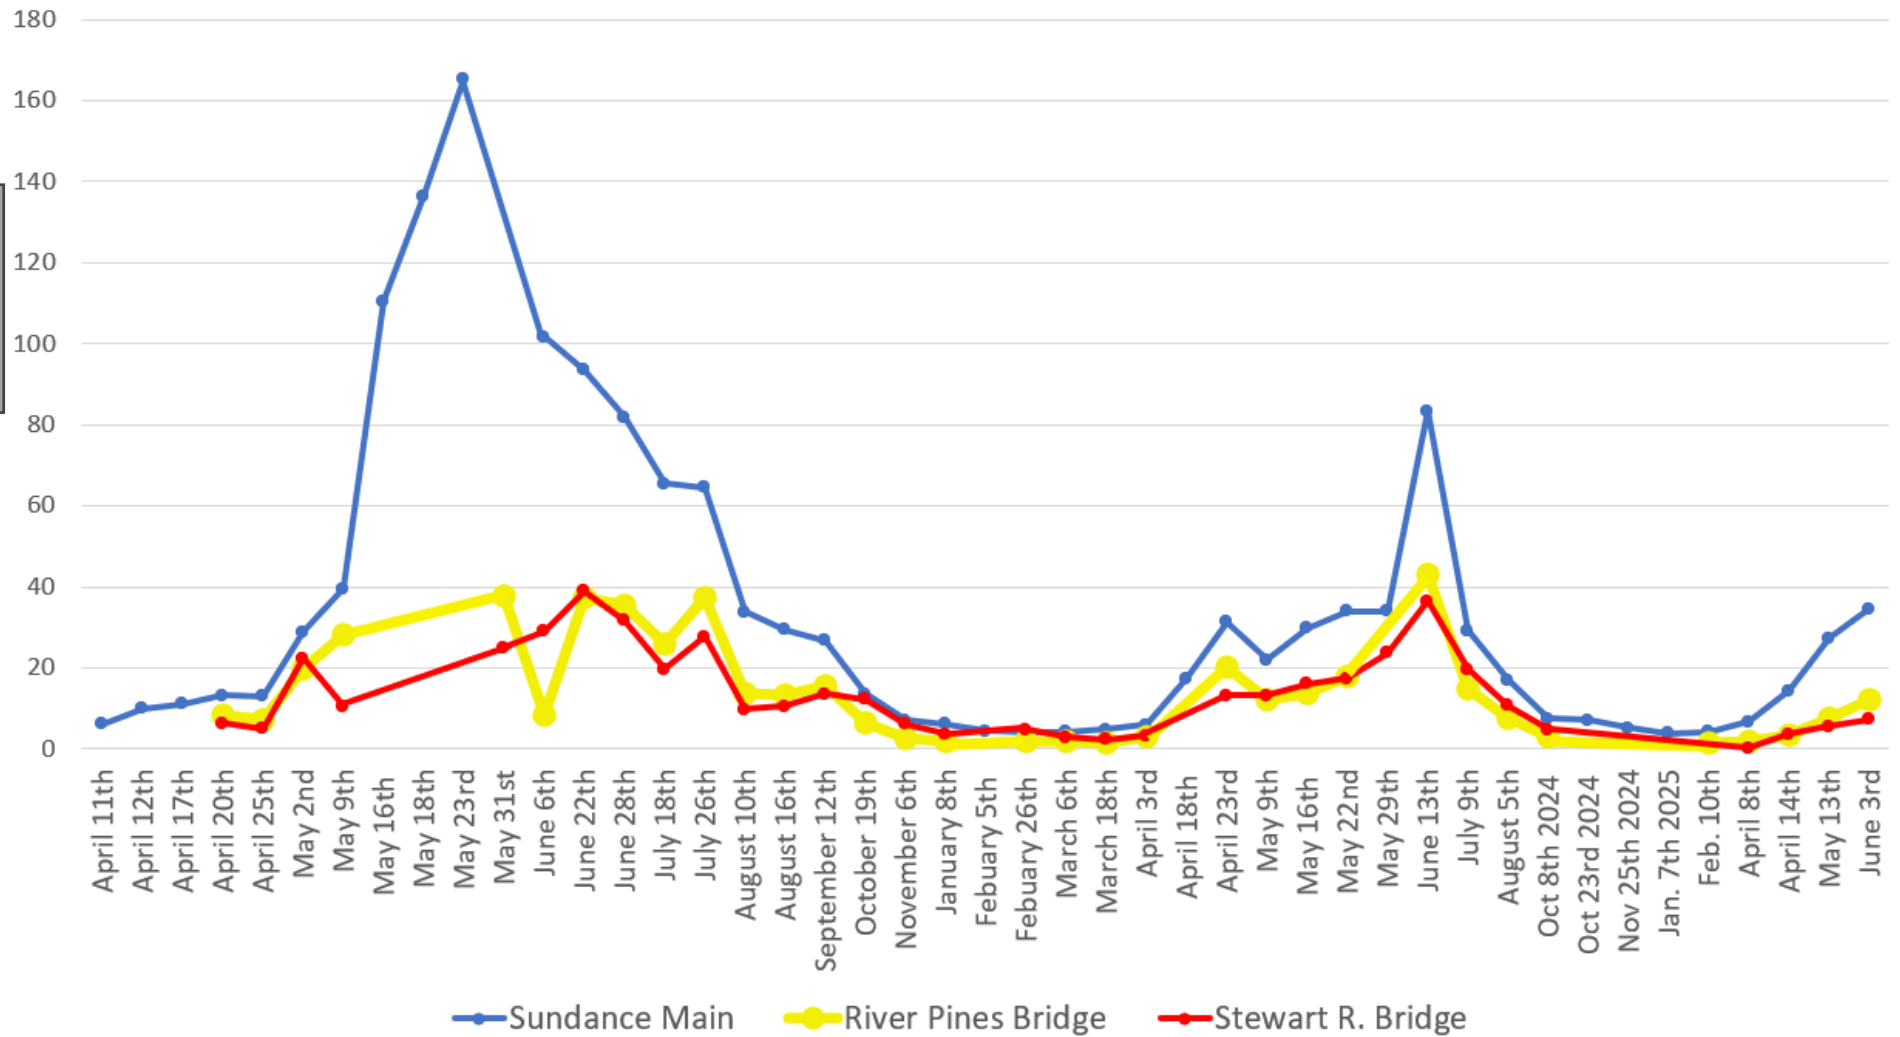

Water Department Information for September


- Our overall water consumption is higher than prior years.
- Aspen Grove wet-well levels are averaging 6.6 feet for September 2025 which is slightly down from last month. This time last year, in September 2024, our average was 7.71 feet.
- Stewart Spring is averaging 89 gpm for September 2025, which is same as last month. This time last year it was averaging 88.52 gpm for September 2024.
- Stewart spring overflow is running 21 gpm for the month of September which is down from last month. Total, Stewart Spring produced an average of 110 gpm for September.
- Unaccounted water
 - Upper Pressure Zone
 - Still at zero.
 - Lower Pressure Zone and Stewart Zone
 - Unaccounted water is 30% all together.
- We have replaced 241 meters so far as of September 7th, 2024. And 239 meters are on cellular endpoints now. We only have a few meters left.
- COP has started construction of the water treatment plant. They have installed the underbuilding pipe lines and are backfilling they are planning to do the foundation soon.
- Aqua is working on master meters and updating the master plan.
- We had a leak detection company go over the system. They found one leak on SCAPO and one on Light side.
- We dug up to repair the Stewart leak location and there was no leak.
- We did asphalt by Three sisters to protect three water valves.
- We did asphalt on multiple meters to move the cellular endpoints to a better location.

- We are now doing multiple water samples every other week. We are completing the PFAS sampling as well.
- We purchased a generator for the Stewart tank pumps. Now that we have two homes on the pressure line we need to have generator backup.
- We need to decide what we want to do with siding


Wastewater Department Information for September

- We have one lab for September, TSS and BOD were out of limits.
- The plant constuction is moving forward they are still working on the foundation.
- We plan is to have the addition roofed and equipment installed in November.
- We are working through the process on keeping the plant operational and bringing new equipment online.
- We need to decide on a secondary screw press
- We need to decide on what we want to do with siding
- The generator automatic transfer switch is having issues and we have our supplier looking for parts. Currently if we lose power, we will have to manually transfer the switches.

Wastewater Labs Chart 2025

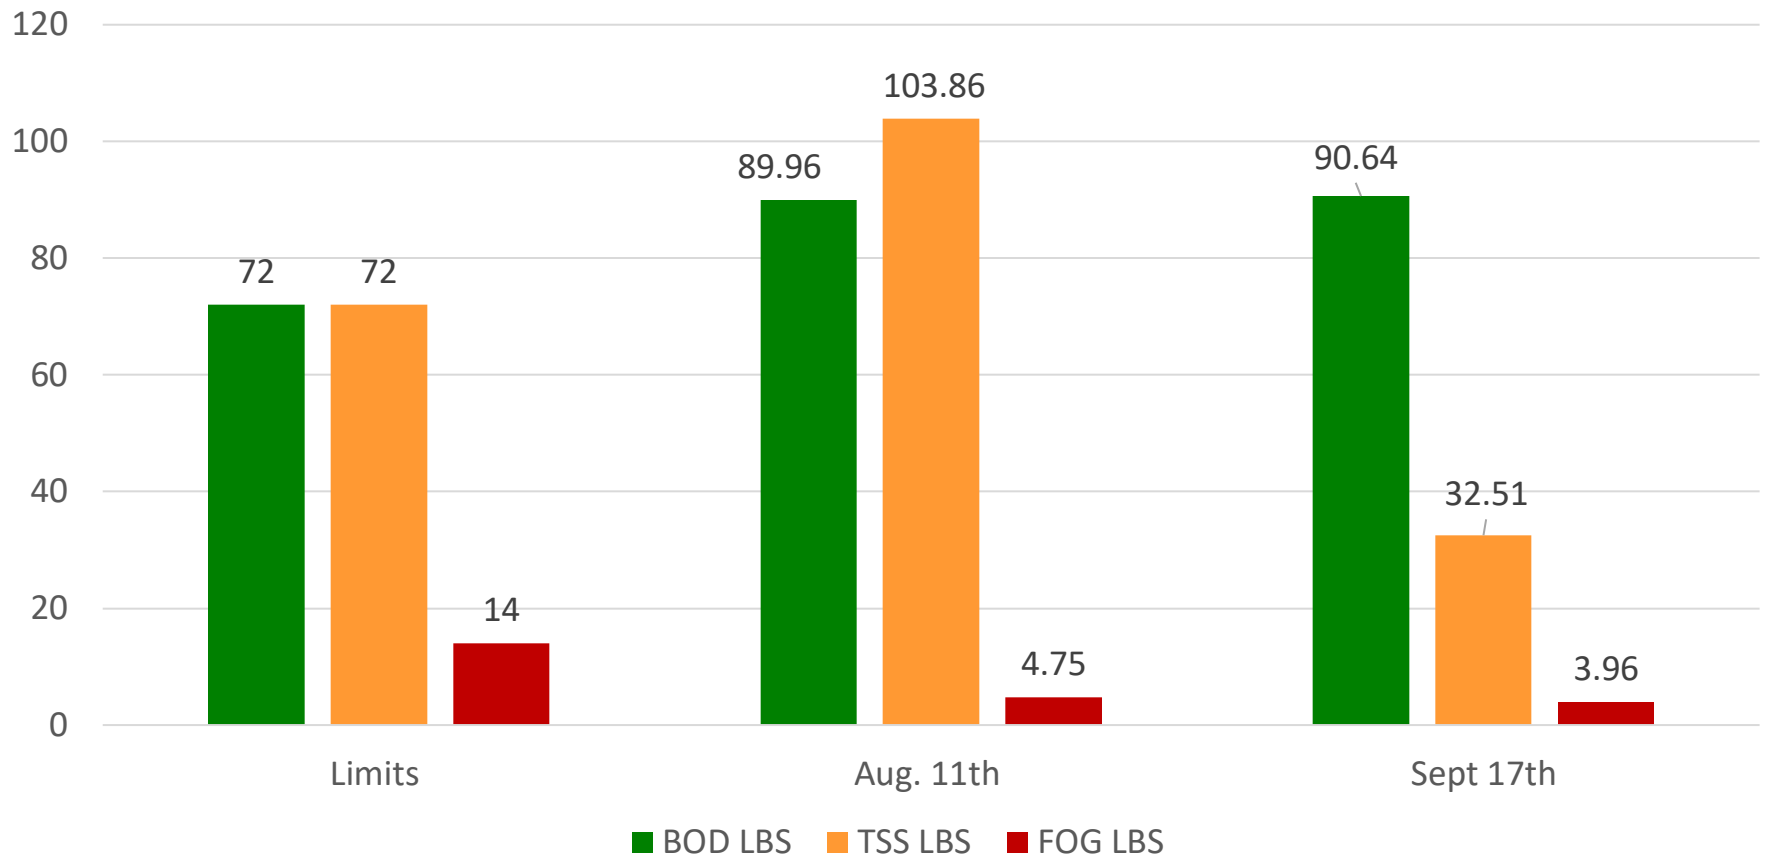

Current Month: 2025

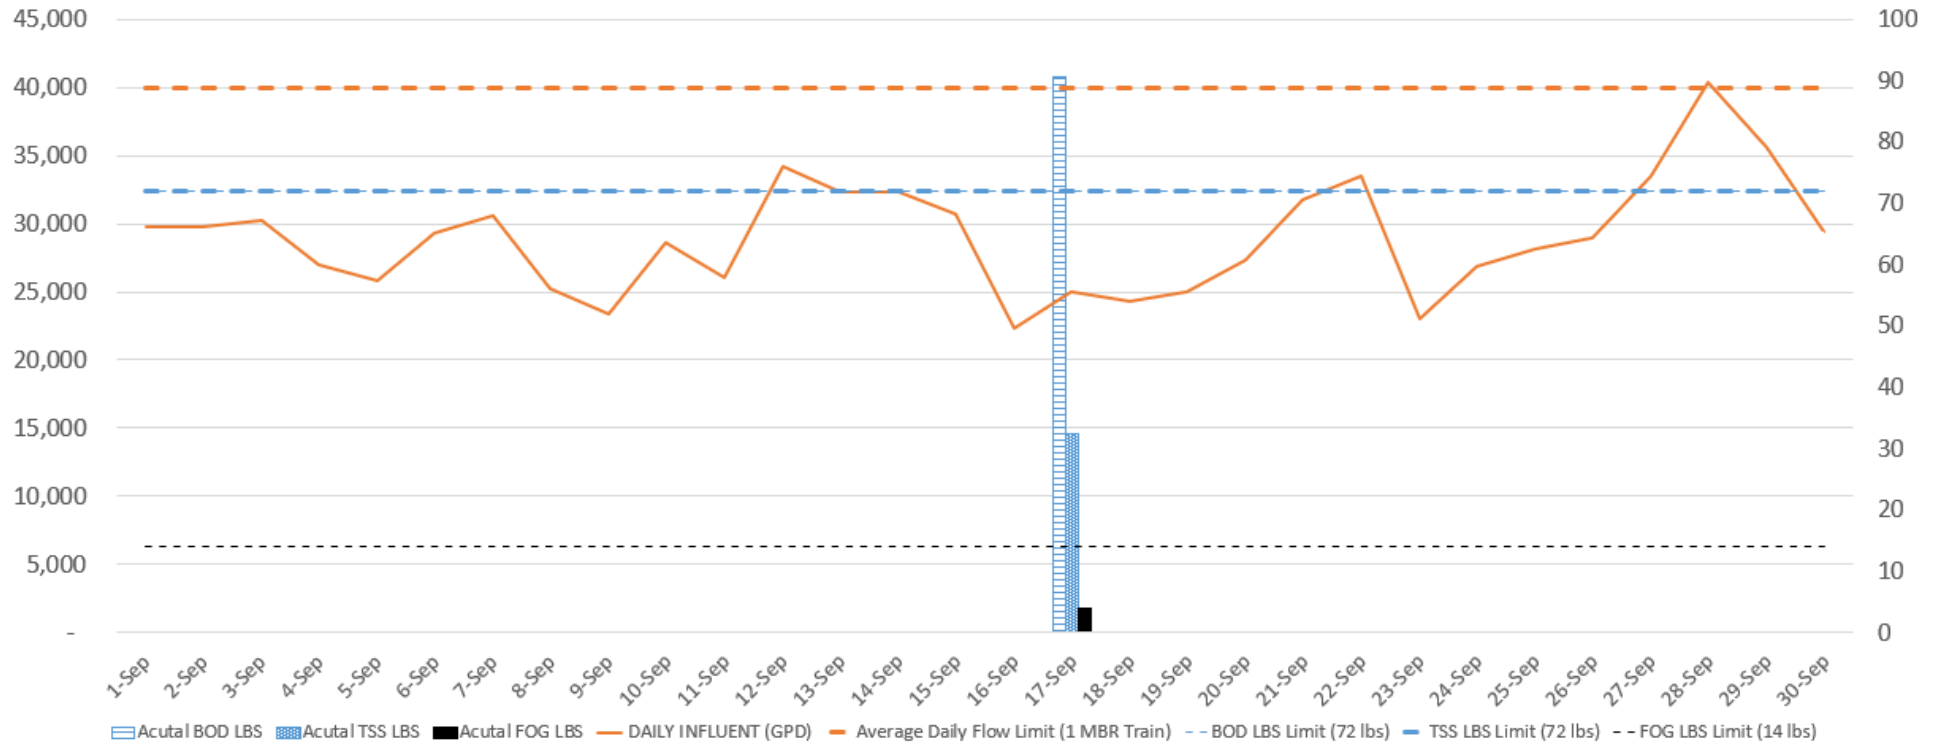

AVERAGE DAILY FLOW (GPD)	29,008
HIGHEST DAILY FLOW (GPD)	40,360

