




IVINS CITY CORPORATE LIMIT LINE  
SANTA CLARA CITY CORPORATE LIMIT LINE

### KEYED NOTES

- ① EXISTING 10 MVA SUBSTATION.
- ② EXISTING 69KV SUBTRANSMISSION LINE WITH 12.5 KV UNDERBUILD
- ③ EXISTING 10 MVA SUBSTATION.
- ④ EXISTING 69KV SUBTRANSMISSION LINE.
- ⑤ EXISTING 3Ø 12.47KV OVERHEAD FEEDER/TIE LINE (69KV UNDERBUILD).
- ⑥ FUTURE SUBSTATION (SOUTH HILLS)
- ⑦ FUTURE 3Ø 69KV OVERHEAD.
- ⑧ FUTURE 69KV SUBTRANSMISSION LINE TO GREEN VALLEY SUB.
- ⑨ FUTURE 3Ø 12.47KV FEEDER/OVERHEAD TIE LINE.
- ⑩ FUTURE 3Ø 12.47KV FEEDER/OVERHEAD TIE LINE (69KV UNDERBUILD).
- ⑪ GENERATION PLANT--12.5 KV TO 69 KV
- ⑫ DGR 5 & 6 12.47 KV COADDITION
- ⑬ ARROW HEAD TO VINEYARD 12.47 KV ADDITION

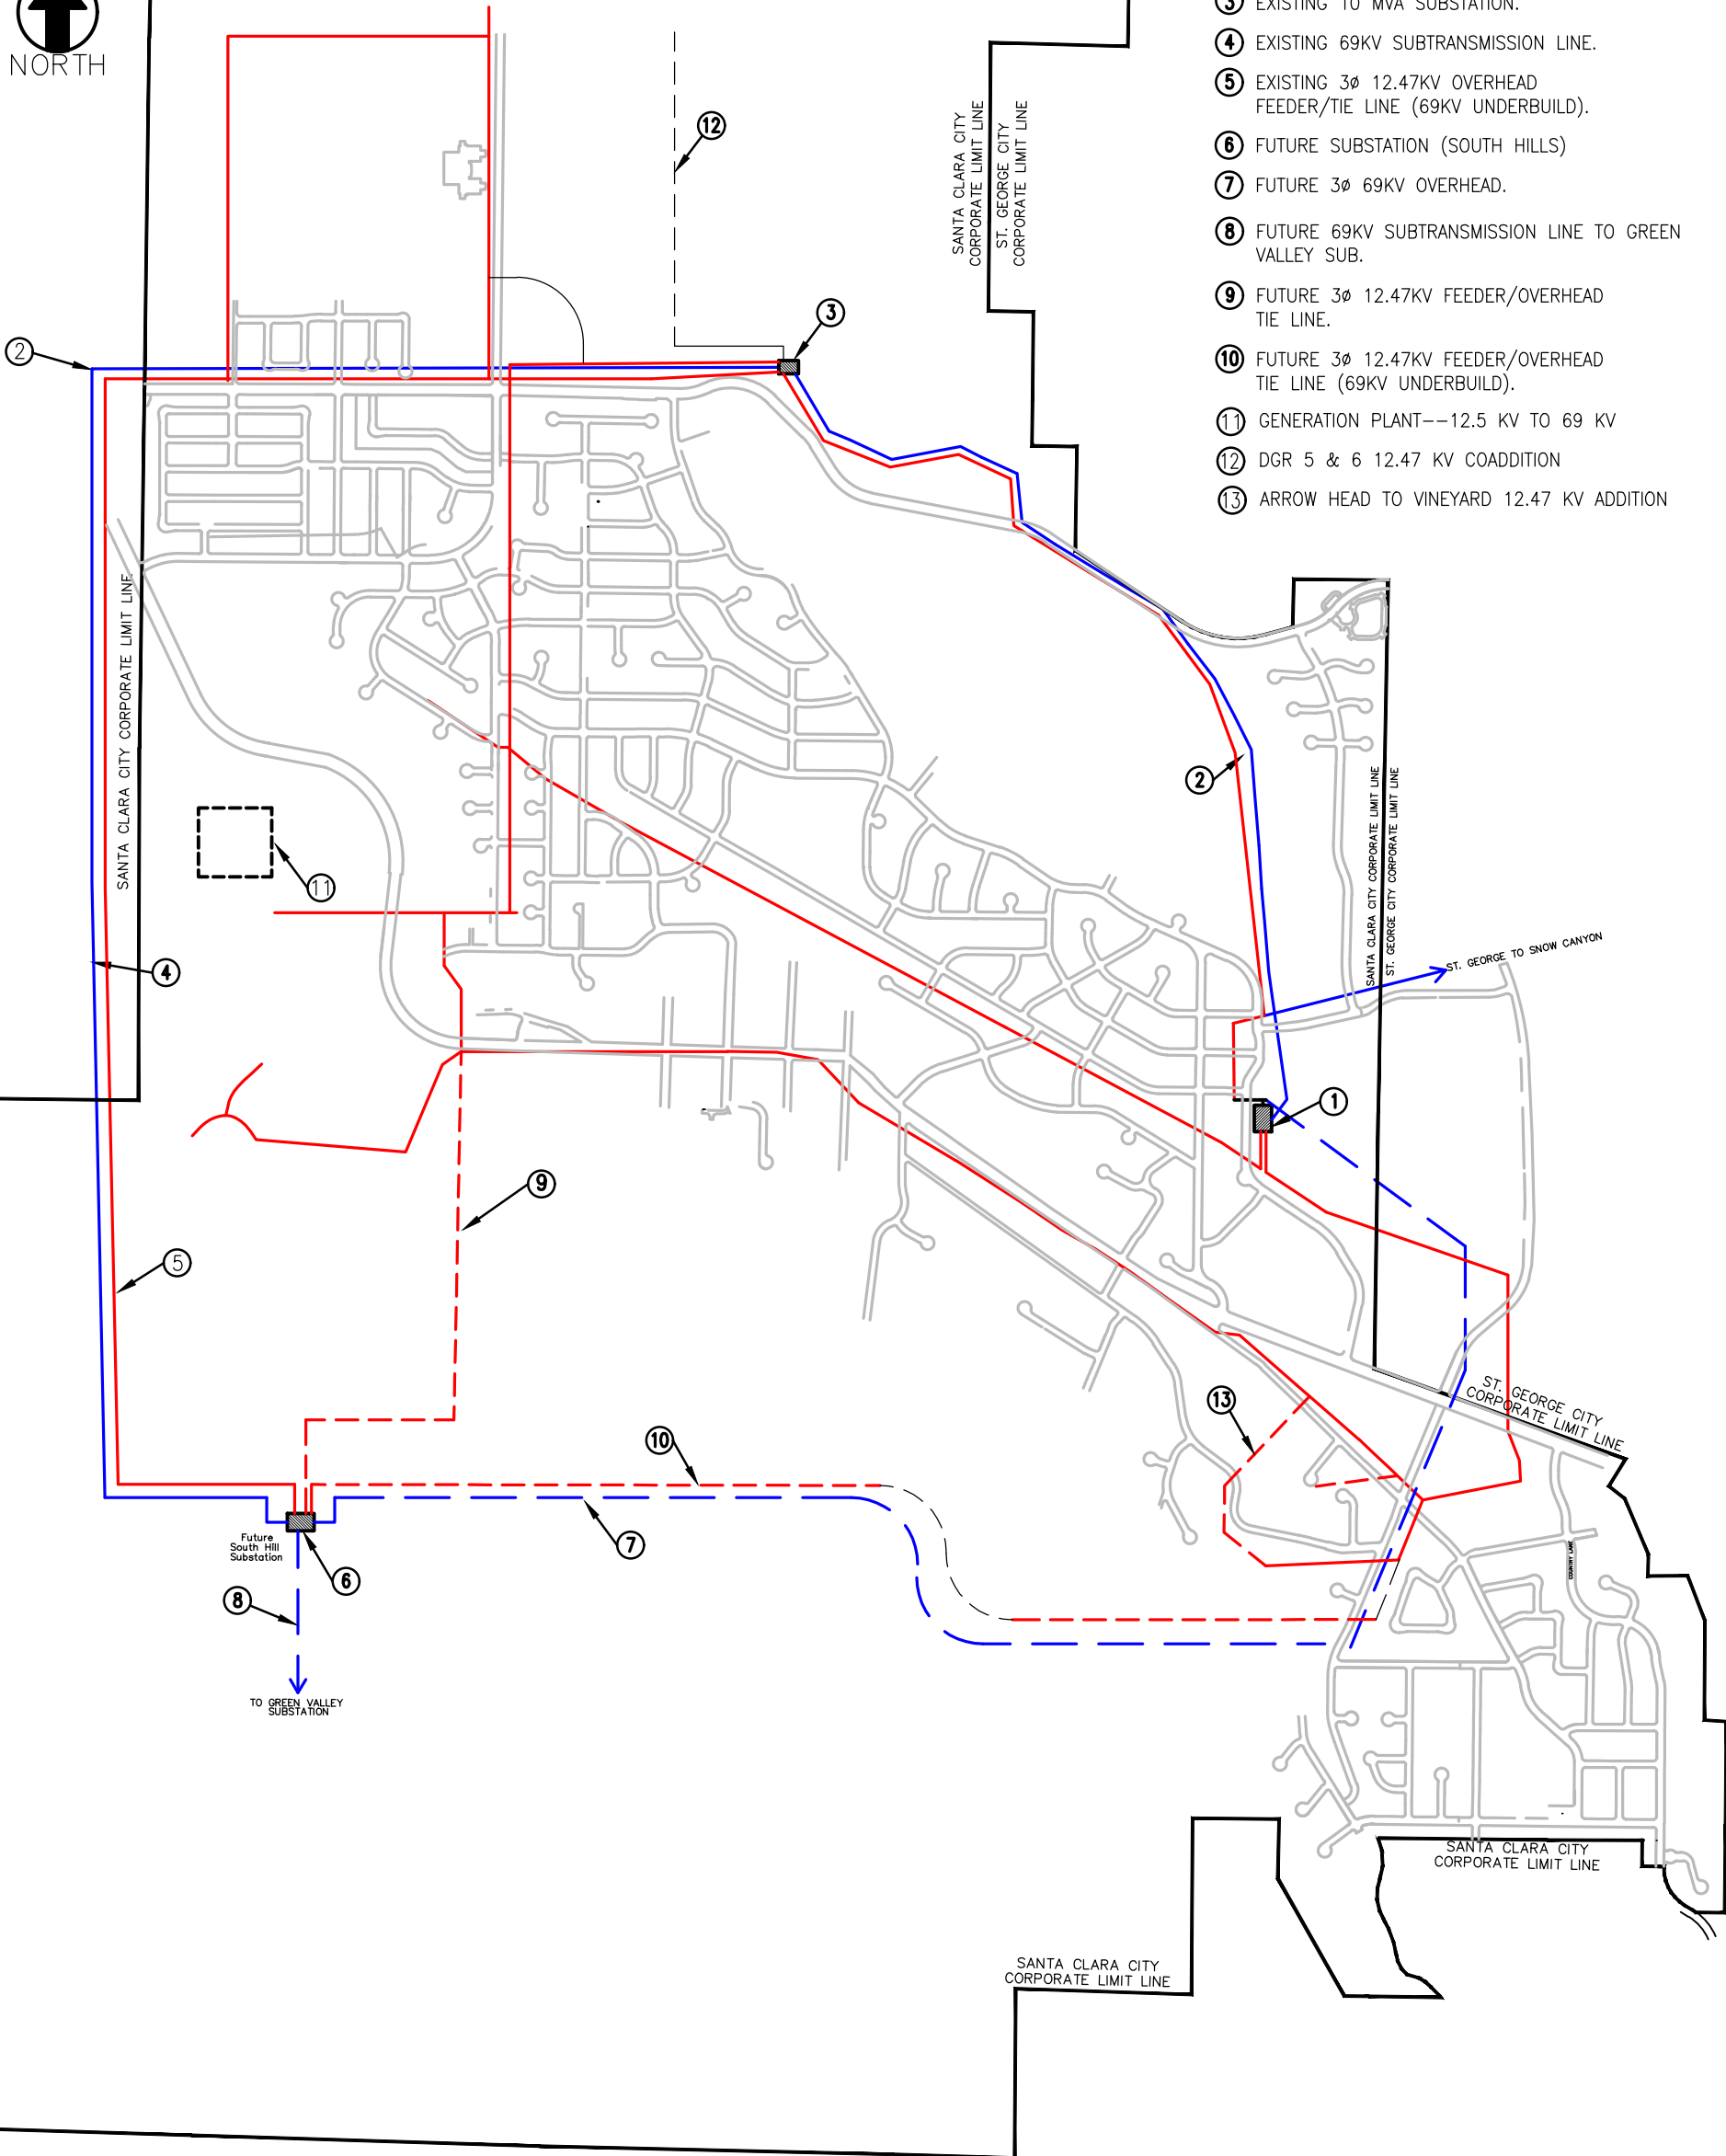

No.	DESCRIPTION	BY	DATE
2	WORK PLAN UPDATE	RF	1/2/22
1	WORK PLAN UPDATE	RF	7/2/15
REVISIONS			
<b>CONFIDENTIAL</b>			

TITLE				<b>SANTA CLARA CITY</b>			
				Long Term Planning Map			
				Distribution and Transmission Lines			
Design By:	RF	Date	12/2021	SCALE	None		
ENGR.	MRV	Date	12/2022	DRAWING No.			
Drafting By:	RF	Project No.	063-022	<b>MAP 3 2</b>	REVISION		