


Monthly Water Usage

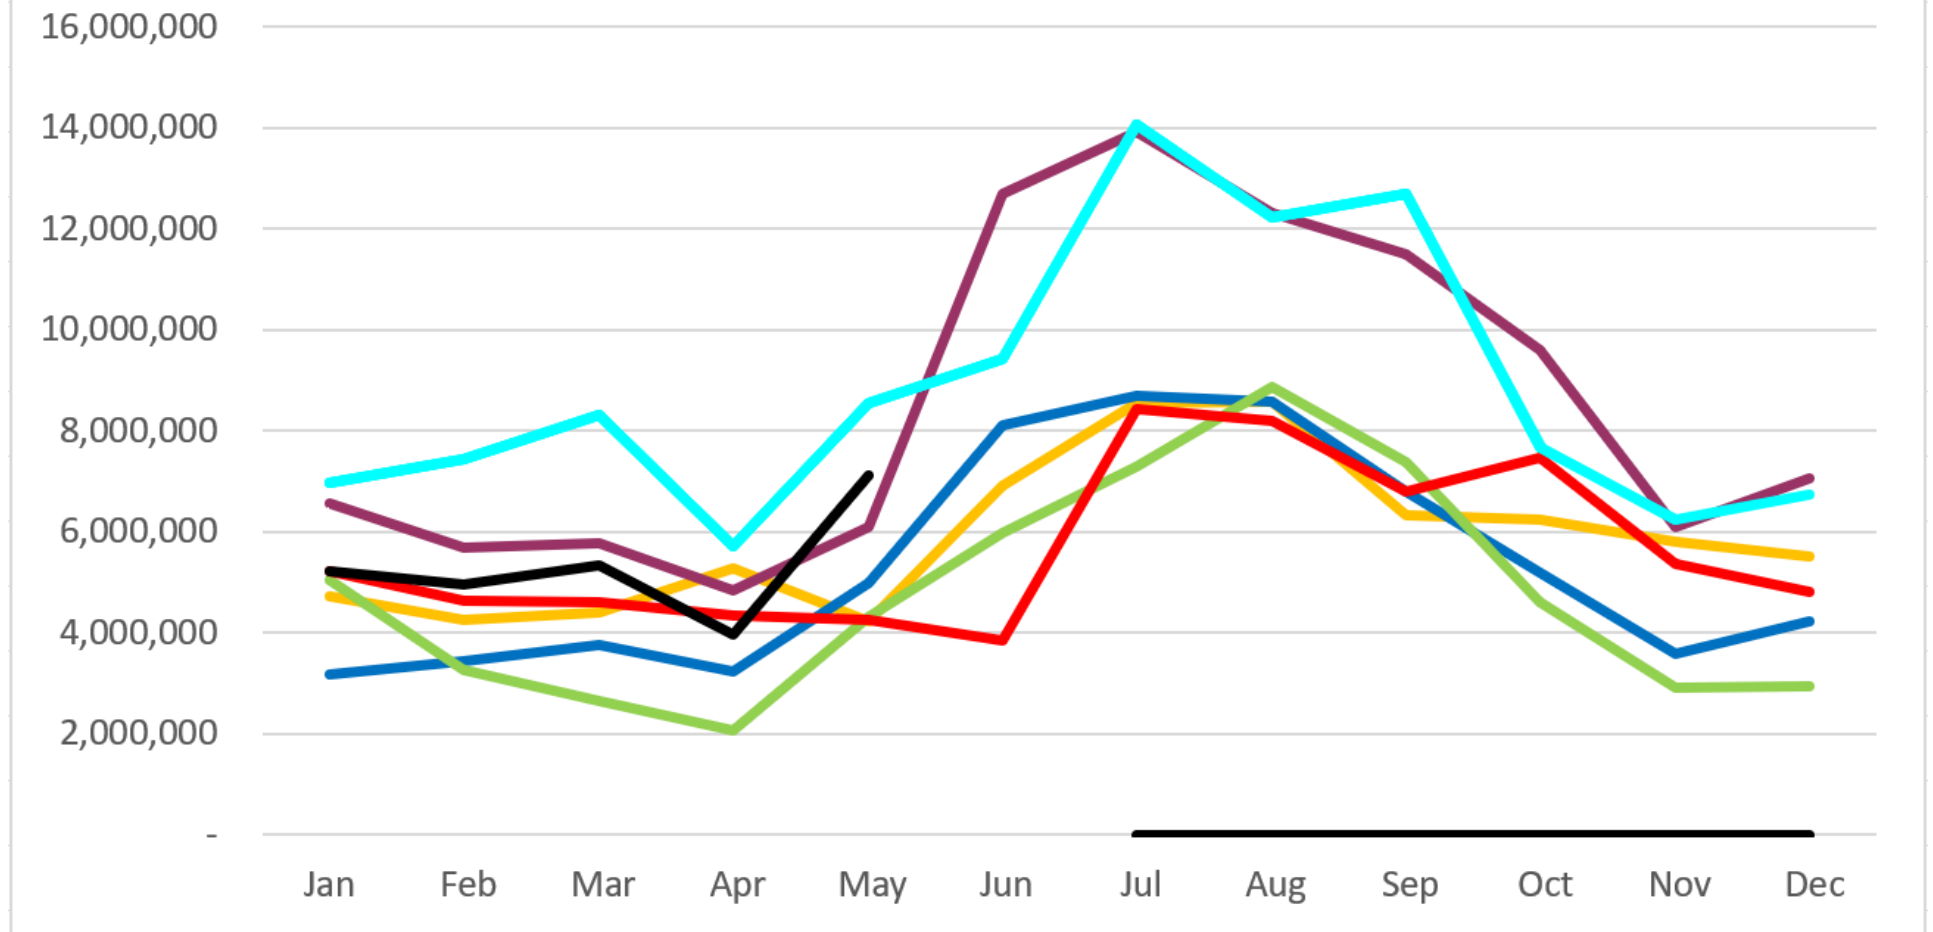

2026 - Black


2025 - Light Blue 2024 - Purple

2023 - Red 2022 - Yellow

2021 - Blue 2020 - Green

May 2026


Source Total: 7,106,603 Gallons

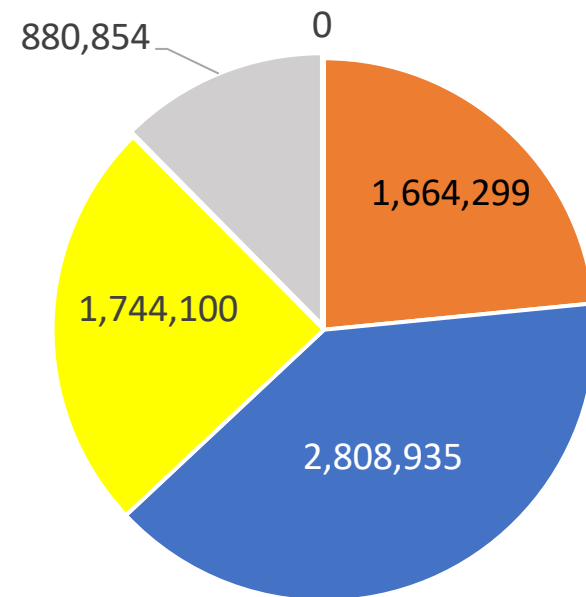

- District Metered Usage
- Conveyed Water Usage
- Unaccounted Stewart Zone
- Unaccounted Lower Pressure zone
- Unaccounted Upper Pressure Zone

C
F
S

April 2023 To Present

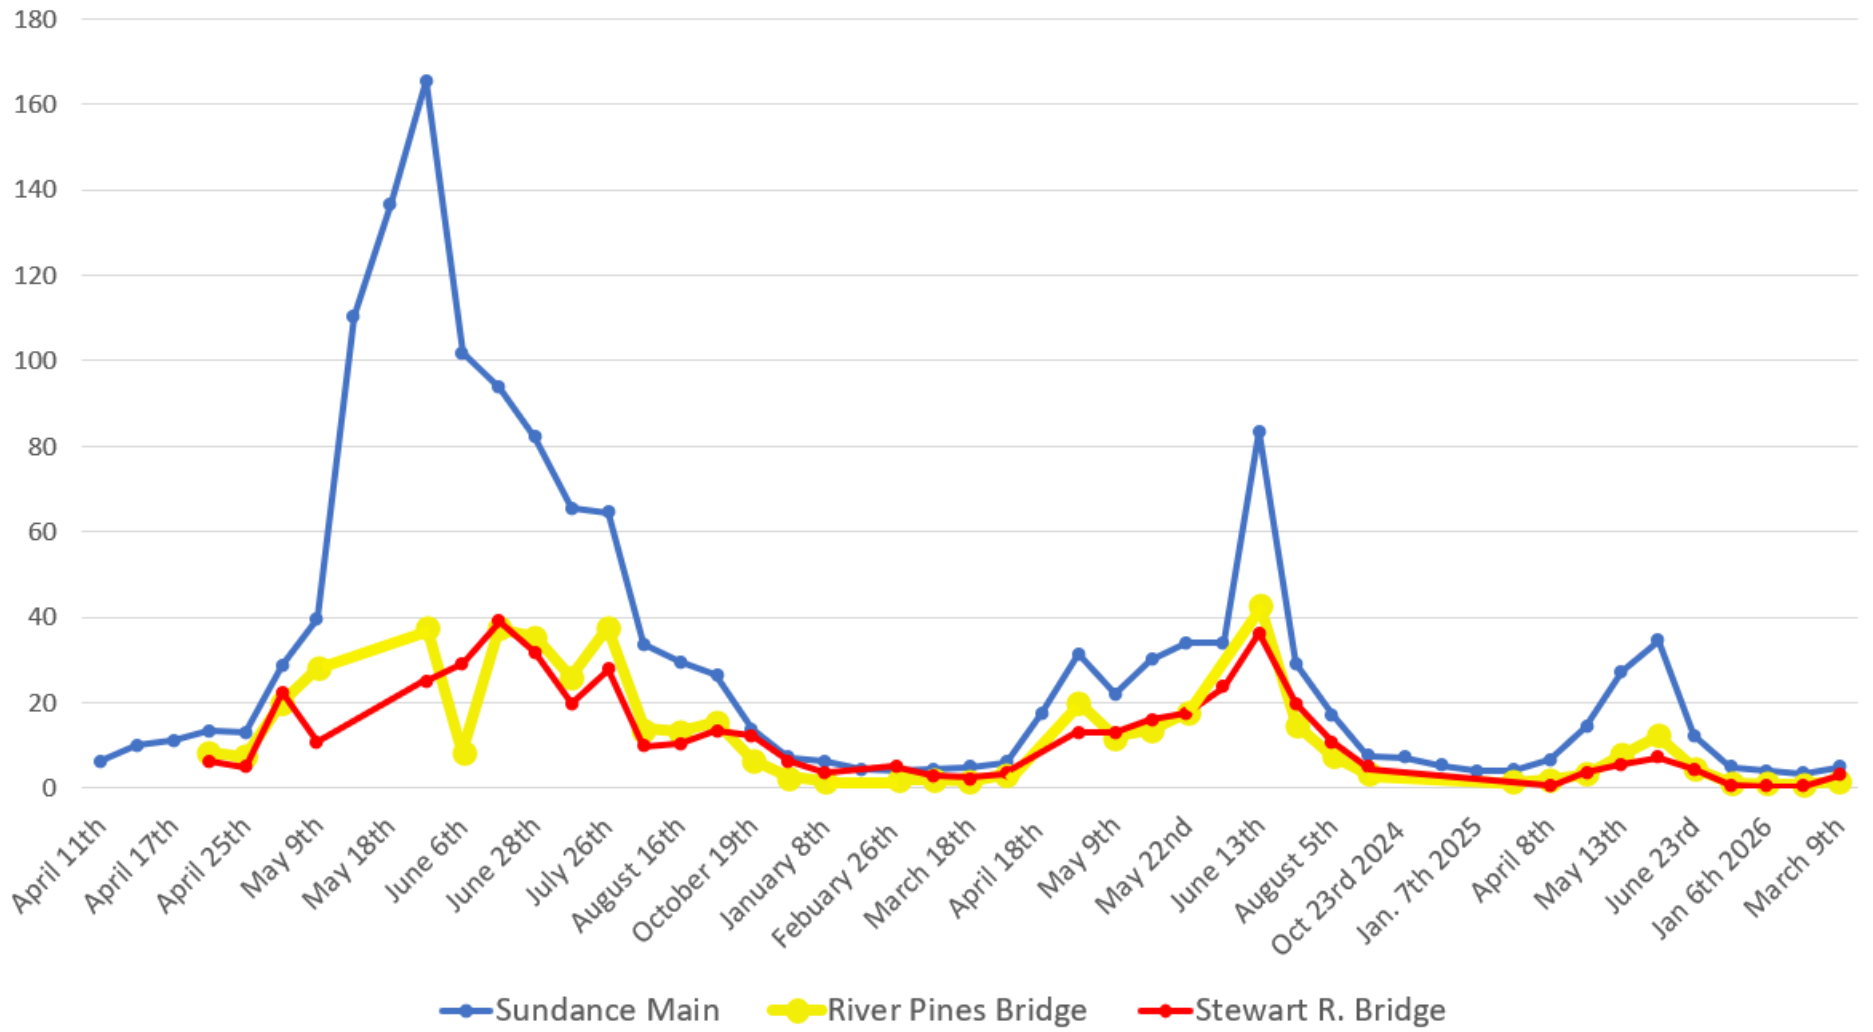


Water Department Information for May


- Our overall water consumption is lower to this time last year.
- Aspen Grove wet-well levels are averaging 7.7 feet for May 2026 which is higher from last month. Currently its sitting at 8.3 ft. This time last year, in May 2025, our average was 8 feet.
- Stewart Spring is averaging 53 gpm for May 2026, which is up from as last month. This time last year it was averaging 104 gpm for May 2025.
- Stewart spring overflow is running 37 gpm for the month of May which is down from last month. Total Stewart Spring produced an average of 90 gpm for May 2026.
- Unaccounted water director
 - Lower Pressure Zone and Stewart Zone
 - Replaced both master meters going into the tanks, Stewart meter had build up in meter lining that makes the reading less accurate. Still need to wire them into our system, waiting for the electricians.
- Construction is almost complete at the treatment plant
- We will be waiting on power.
- Landscaping is complete.
- Repaired a leak on Timphaven caused by the power line going in.
- Dug up and fixed a valve by the crossover.
- We are getting a lot of blue stakes on water lines.
- We have had 17 submit lead and copper surveys up from 4 last month.
- We have been working on Aspen Grove pump house.

- Leak Equipment has been purchased should receive it any day.
- Unaccounted water elimination processes:
 - We have replaced almost all the service meters including the 6-inch meters.
 - Corrected meters with wrong calculations, and mismatched register sizes.
 - We have had the spring meters heartbeat checked multiple times
 - We have had 2 leak detection companies conduct leak surveys
 - We have fixed multiple leaks
 - We have replaced 2 leaking hydrants.
 - We have inspected about 50 percent of the hydrants with a camera device.
 - We have had all the PRV's inspected and replaced one 6 inch one 4 inch and two 2 inch PRV's
 - We eliminated a section of old pipe on coming from the old Stewart Tank
 - We isolated Stewart tank to check for tank leaks.
 - We have two new zero meters ordered to replace the spring meters.
 - We started isolating zones in the system by transferring usage from Stewart to Aspen grove sides.
 - Leak locators came back out.
 - Dug and fixed a leak on Stewart rd.
 - Replaced both spring meters.

Wastewater Department Information for May

- We have one lab for May; all were within limits.
- MBR tank 3 is finished, they are trying to reduce water loss.
- We are still having issues with the blowers we are waiting for electrical engineers
- Sundance is planning to repair our electrical lines that were hit on the upper drain field.

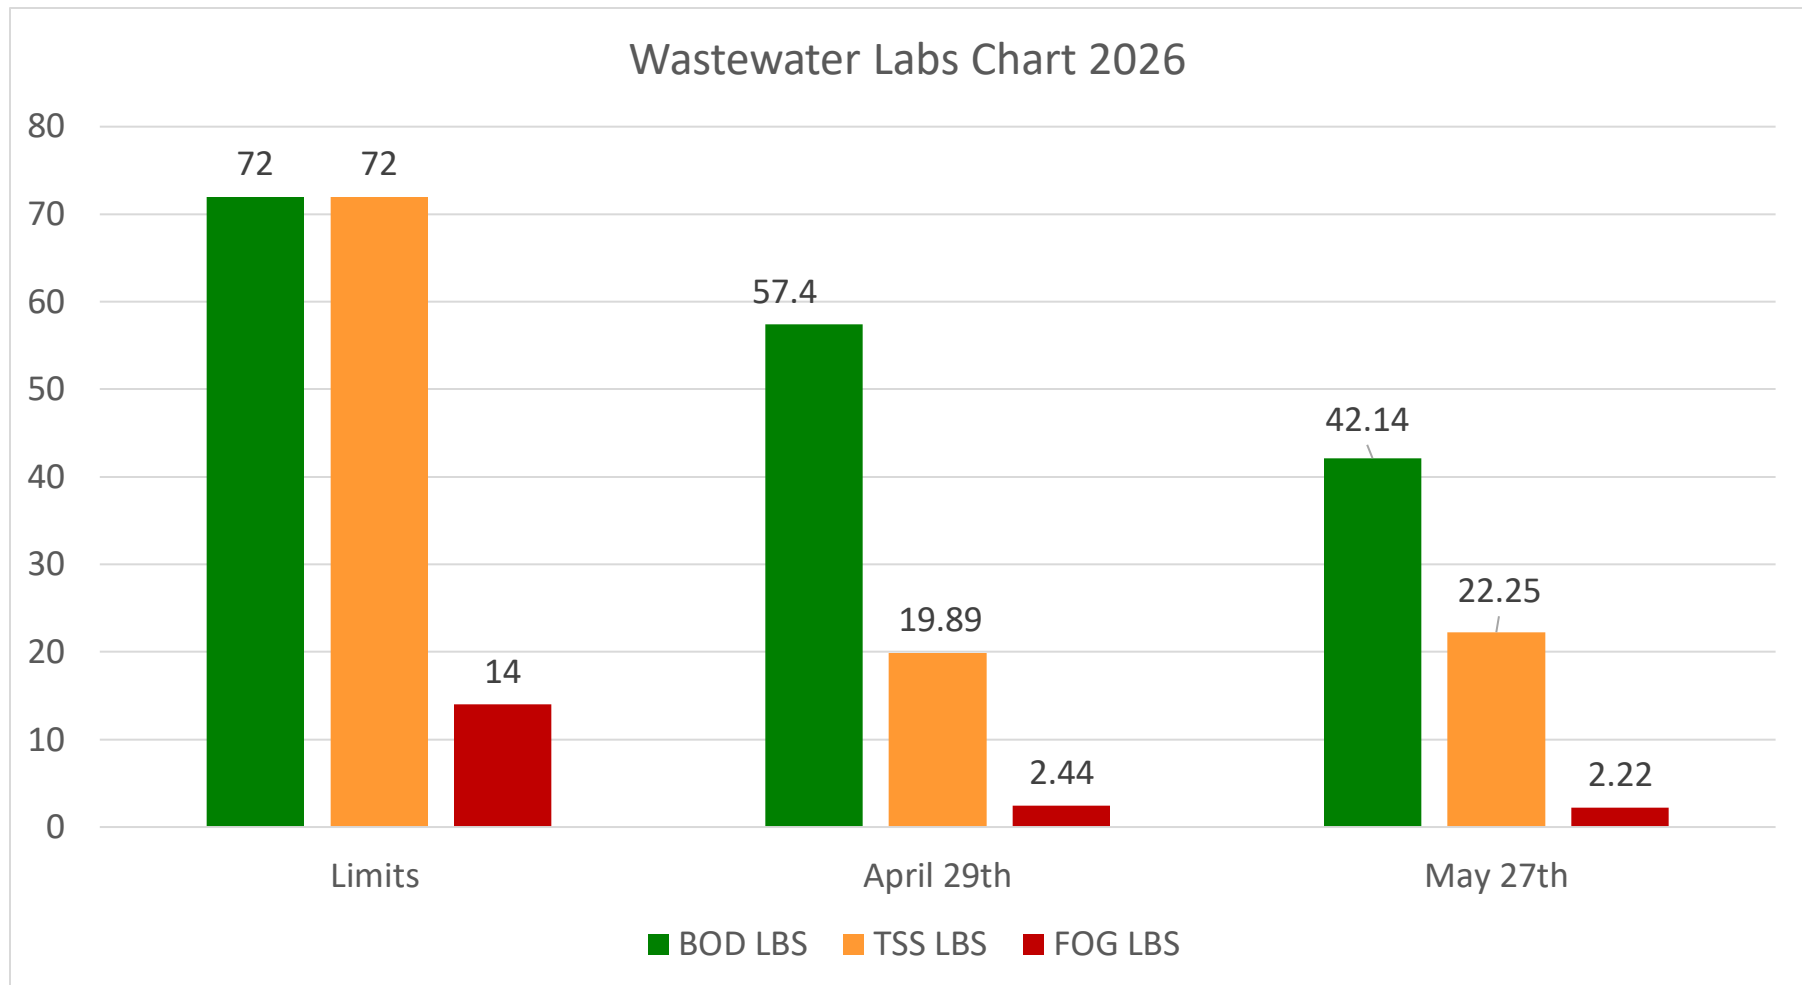

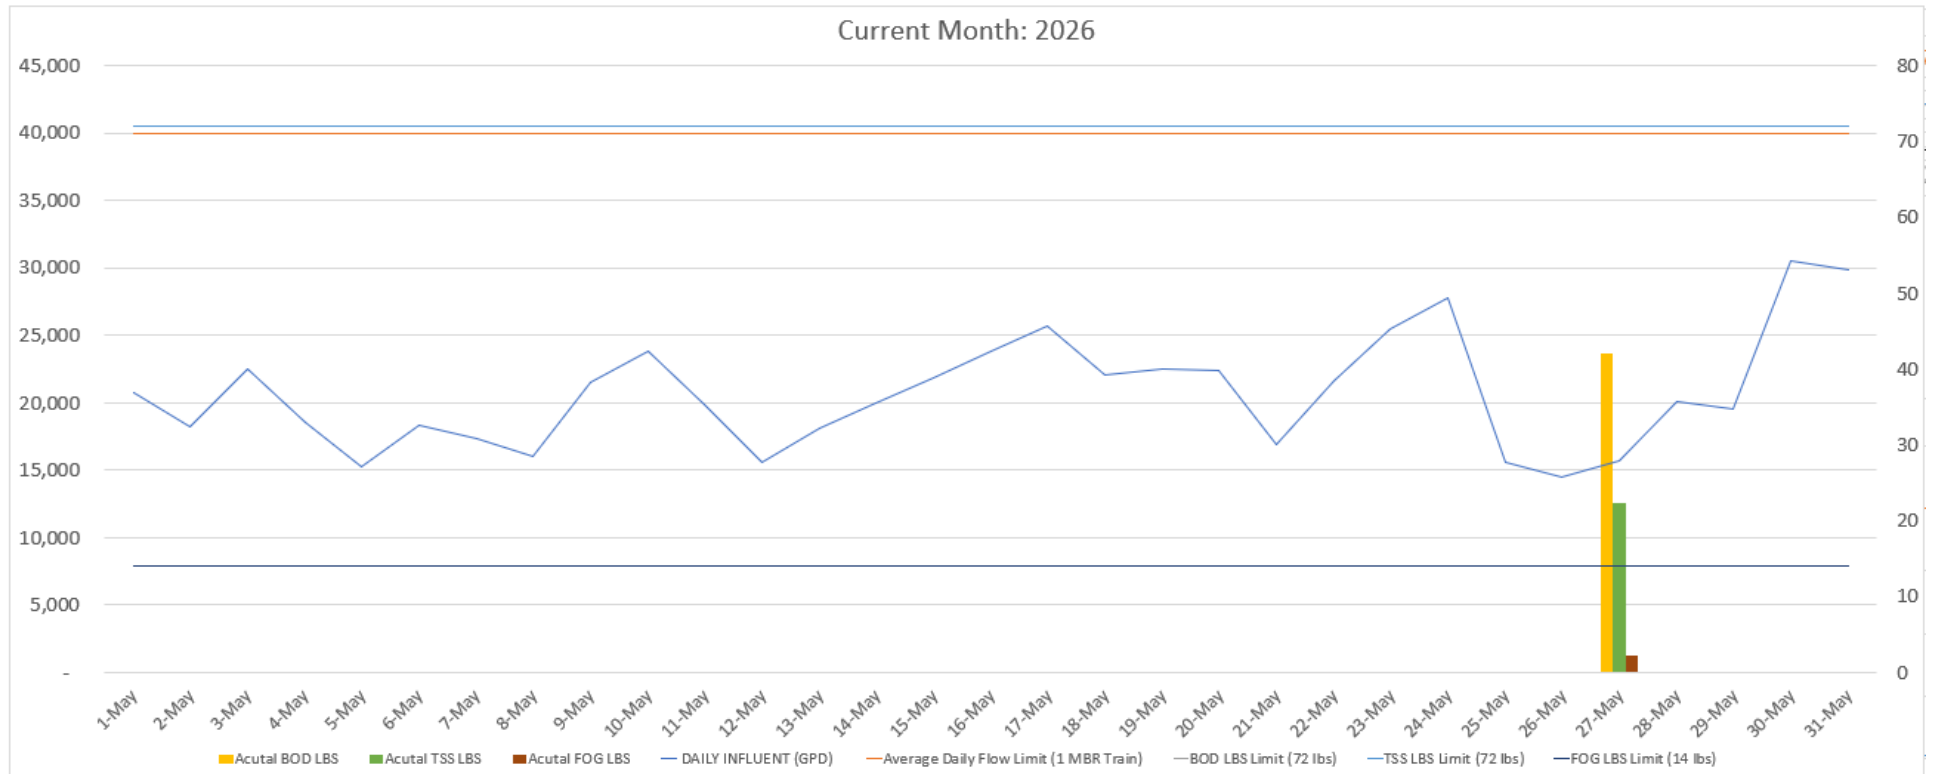

AVERAGE DAILY FLOW (GPD)	20,700
HIGHEST DAILY FLOW (GPD)	30,546

