


Monthly Water Usage

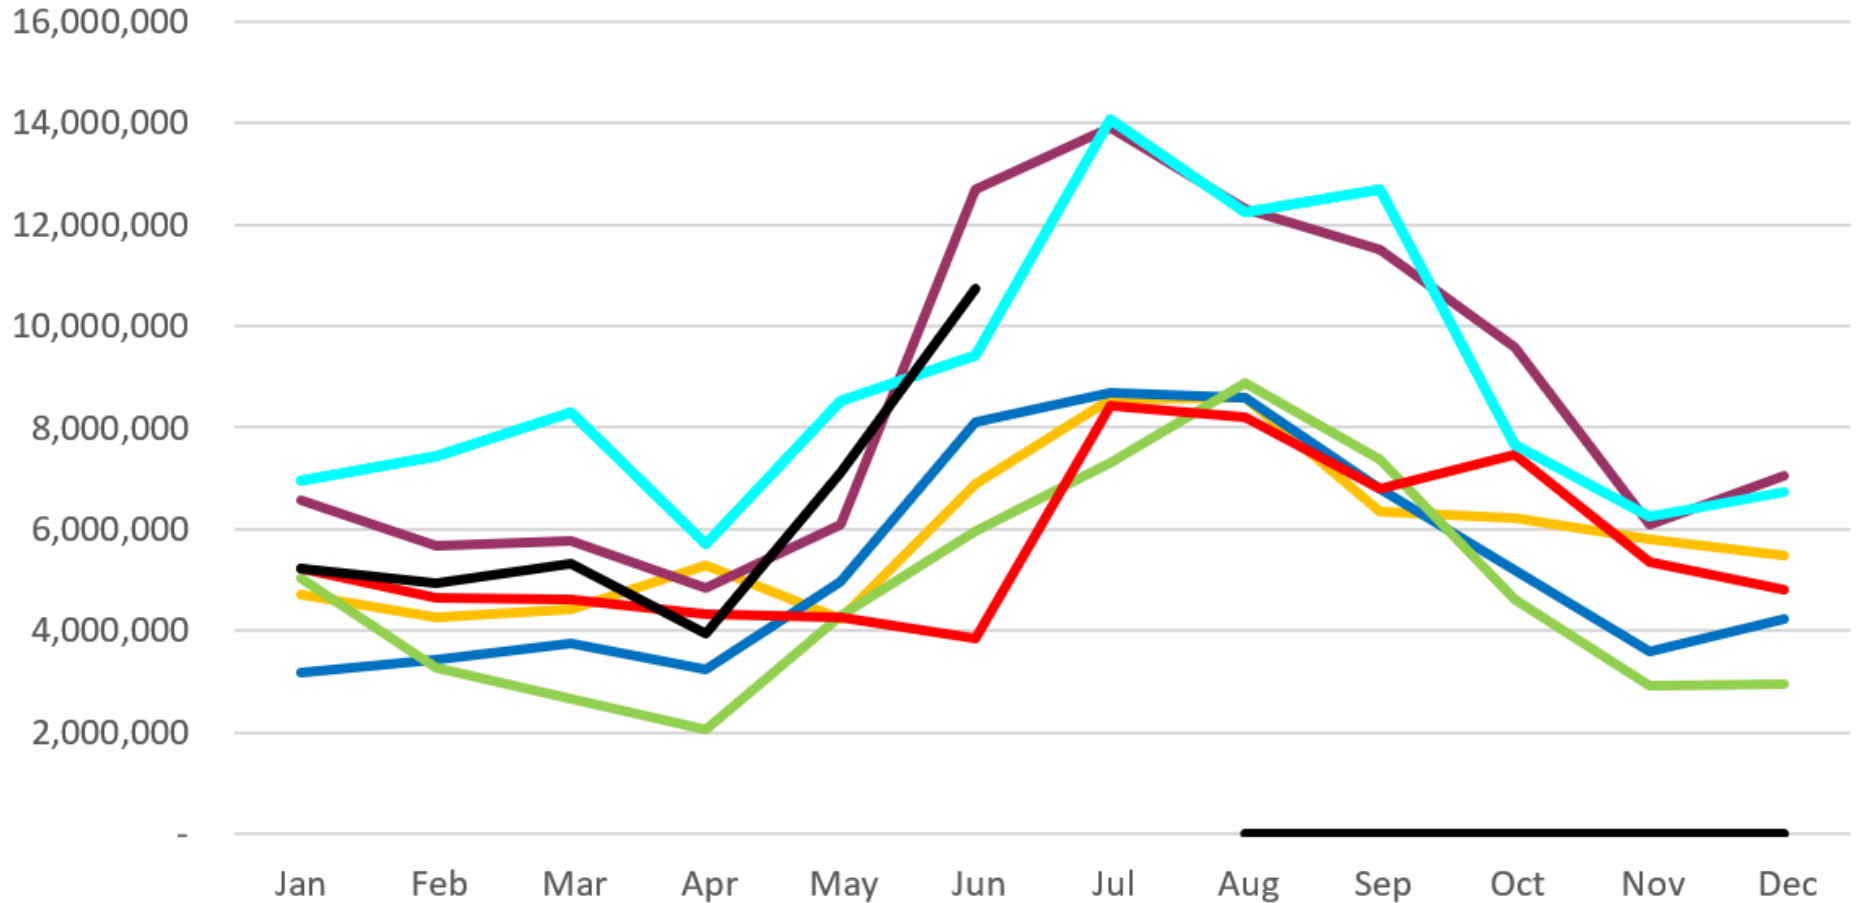

2026 - Black


2025 - Light Blue 2024 - Purple

2023 - Red 2022 - Yellow

2021 - Blue 2020 - Green

June 2026


Source Total: 10,743,921 Gallons

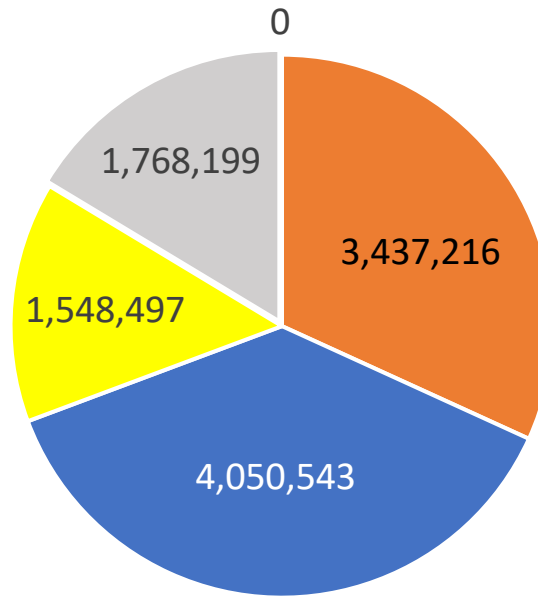

- District Metered Usage
- Conveyed Water Usage
- Unaccounted Stewart Zone
- Unaccounted Lower Pressure zone
- Unaccounted Upper Pressure Zone

April 2023 To Present

C
F
S

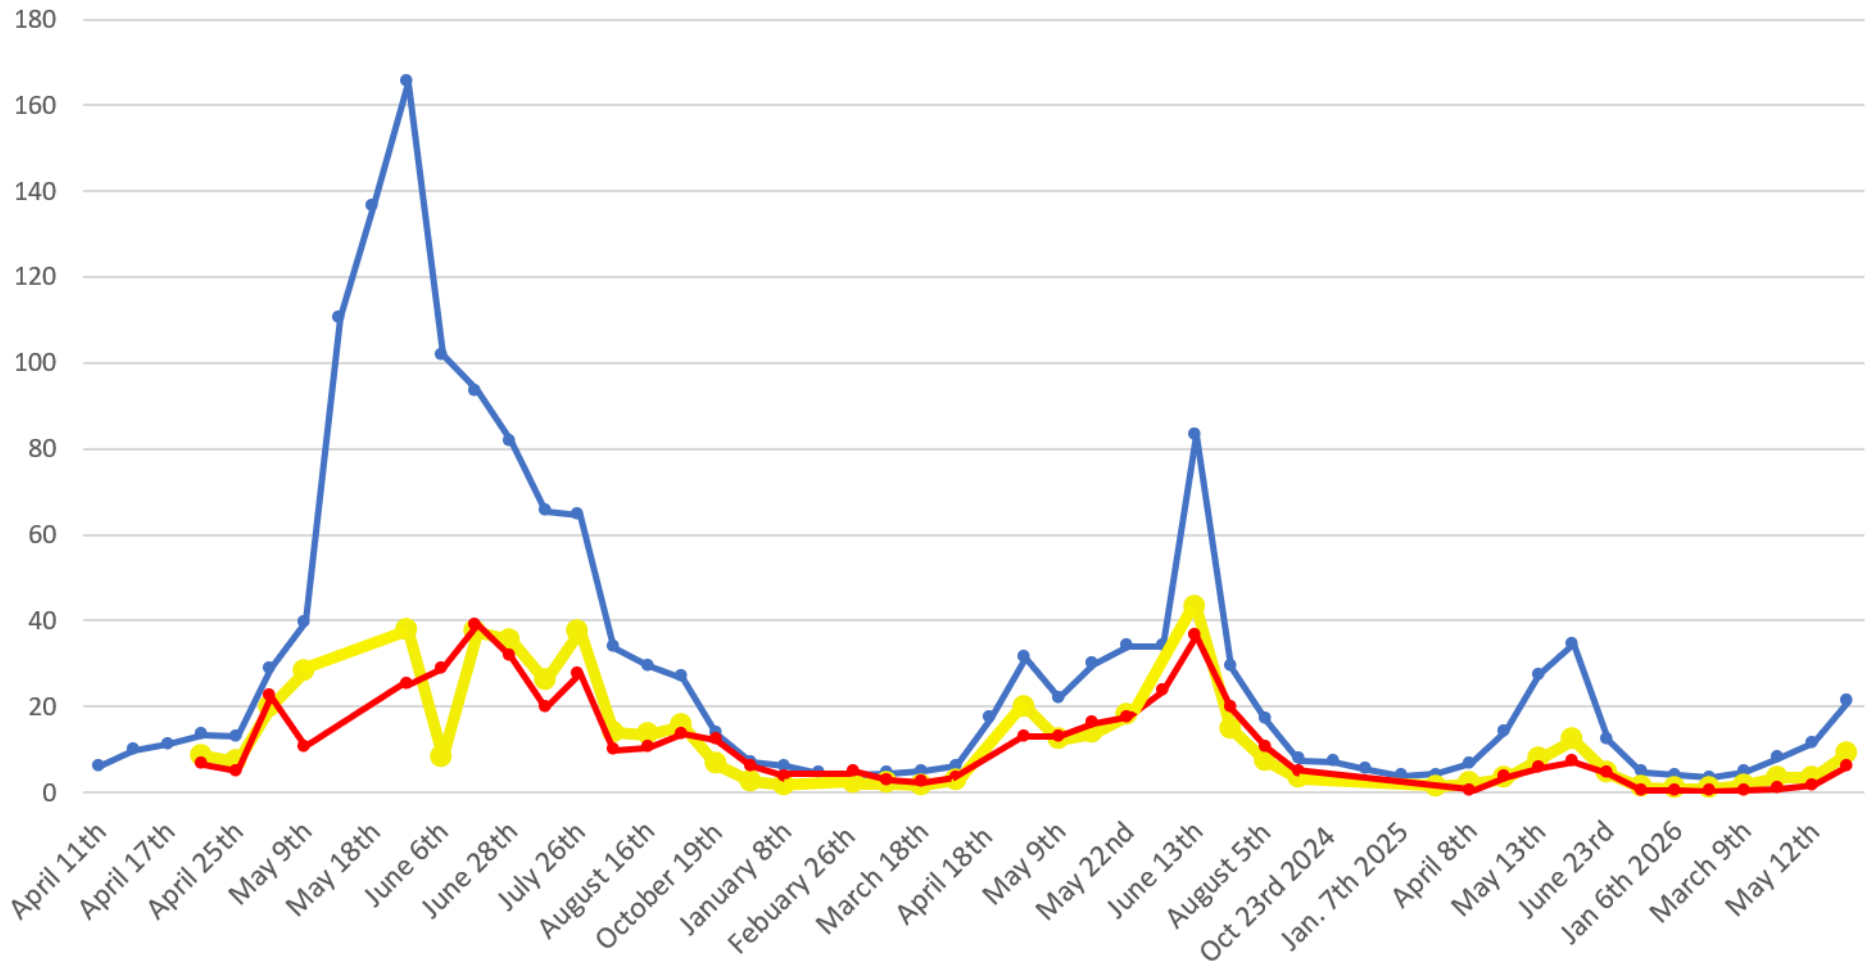

Water Department Information for June


- Our overall water consumption is a little higher than this time last year.
- Aspen Grove wet-well levels are averaging 7.7 feet for June 2026 which is higher from last month. Currently its sitting at 8.3 ft. This time last year, in June 2025, our average was 8 feet.
- Stewart Spring is averaging 53 gpm for June 2026, which is up from as last month. This time last year it was averaging 104 gpm for June 2025.
- Stewart spring overflow is running 37 gpm for the month of June which is down from last month. Total Stewart Spring produced an average of 90 gpm for June 2026.
- Construction is almost complete at the treatment plant
 - Power conduit is installed. Waiting on RMP to pull and energize the line.
- We found a leak with the new equipment near the leak we just repaired on stewart rd.
- We are getting a lot of blue stakes on water lines.
- We have had 71 submit lead and copper surveys up from 34 last month.
- Unaccounted water elimination processes:
 - We have replaced almost all the service meters including the 6-inch meters.
 - Corrected meters with wrong calculations, and mismatched register sizes.
 - We have had the spring meters heartbeat checked multiple times
 - We have had 2 leak detection companies conduct leak surveys
 - We have fixed multiple leaks
 - We have replaced 2 leaking hydrants.
 - We have inspected about 50 percent of the hydrants with a camera device.
 - We have had all the PRV's inspected and replaced one 6 inch one 4 inch and two 2 inch PRV's


- We eliminated a section of old pipe on coming from the old Stewart Tank
- We isolated Stewart tank to check for tank leaks.
- We have two new zero meters ordered to replace the spring meters.
- We started isolating zones in the system by transferring usage from Stewart to Aspen grove sides.
- Leak locators came back out.
- Dug and fixed a leak on Stewart rd.
- Replaced both spring meters.

Wastewater Department Information for June

- We have one lab for June; all were within limits.
- MBR tank 3 should be online.
- We are still having issues with the blowers we are waiting for electrical engineers
- Sundance is planning to repair our electrical lines that were hit on the upper drain field.
 - Update they have put a new conduit in now we just need the line put in and wired up.

Wastewater Labs Chart 2026

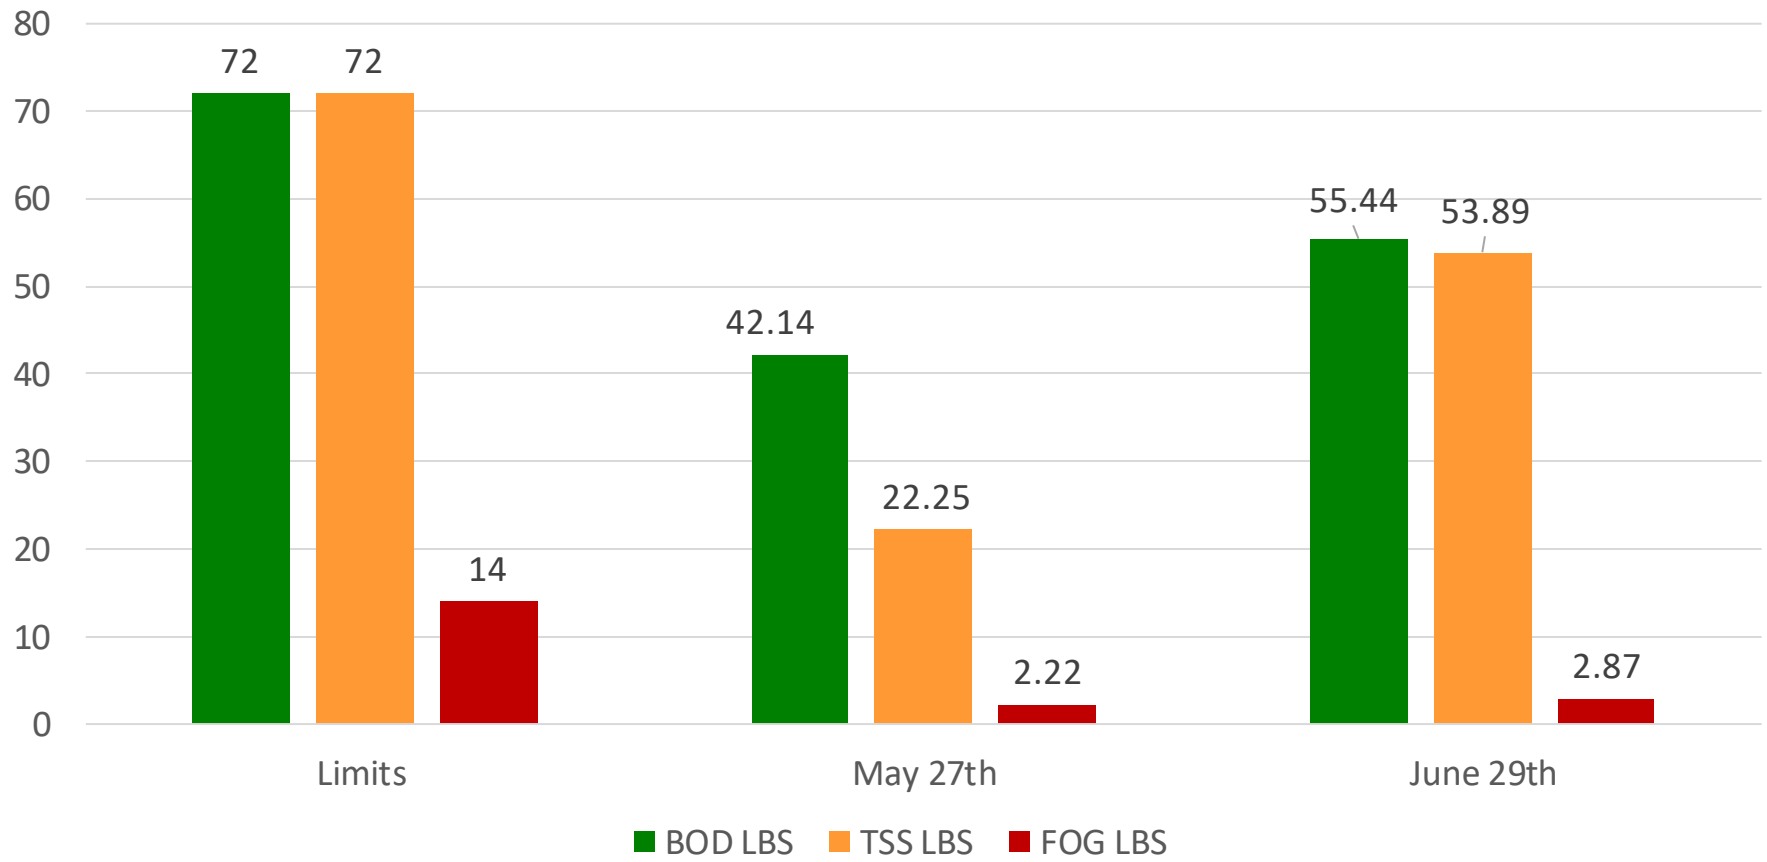

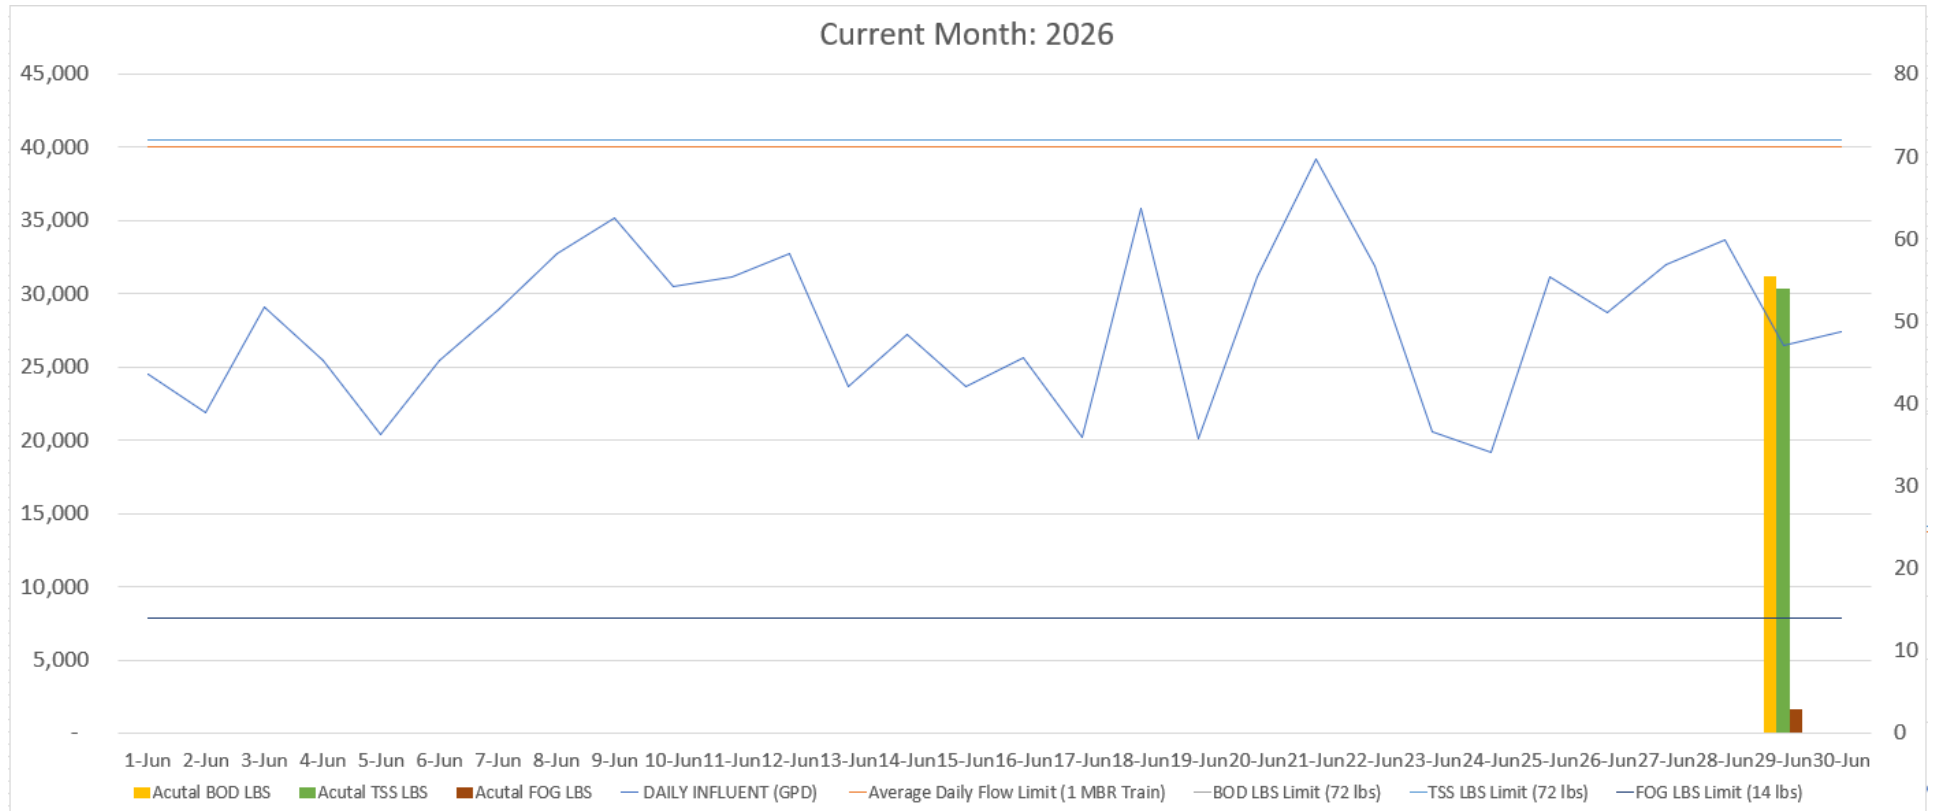

AVERAGE DAILY FLOW (GPD)	27,854
HIGHEST DAILY FLOW (GPD)	39,198

