

RESOLUTION 21-13

A RESOLUTION AMENDING THE DESIGN STANDARDS AND CONSTRUCTION SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION IN HYRUM CITY.

WHEREAS, the Hyrum City Council approved the revised Design Standards and Construction Specifications for Public Works Construction in Hyrum City in January 2003; and

WHEREAS, the Design Standards and Construction Specifications for Public Work Construction provides general requirements and design guidelines for installation of utilities and other public improvements in Hyrum City; and

WHEREAS, upon recommendation of Hyrum City's Engineer and Public Works Department, the City Council has determined there is a need to amend and update Hyrum City's Design Standards and Construction Specifications for Public Works Construction.

NOW, THEREFORE, BE IT RESOLVED by the City Council of Hyrum, Cache County, Utah, to approve the revisions, attached hereto as Exhibit "A", to Hyrum City's Design Standards and Construction Specifications for Public Works Construction in Hyrum

THIS RESOLUTION shall become effective upon adoption.

ADOPTED AND PASSED by the Hyrum City Council this 17th day of June, 2021.


HYRUM CITY CORP.

BY: _____
Stephanie Miller
Mayor

ATTEST:

Stephanie Fricke
City Recorder



CURRENT IRRIGATION SERVICE STANDARD TO BE REPLACED

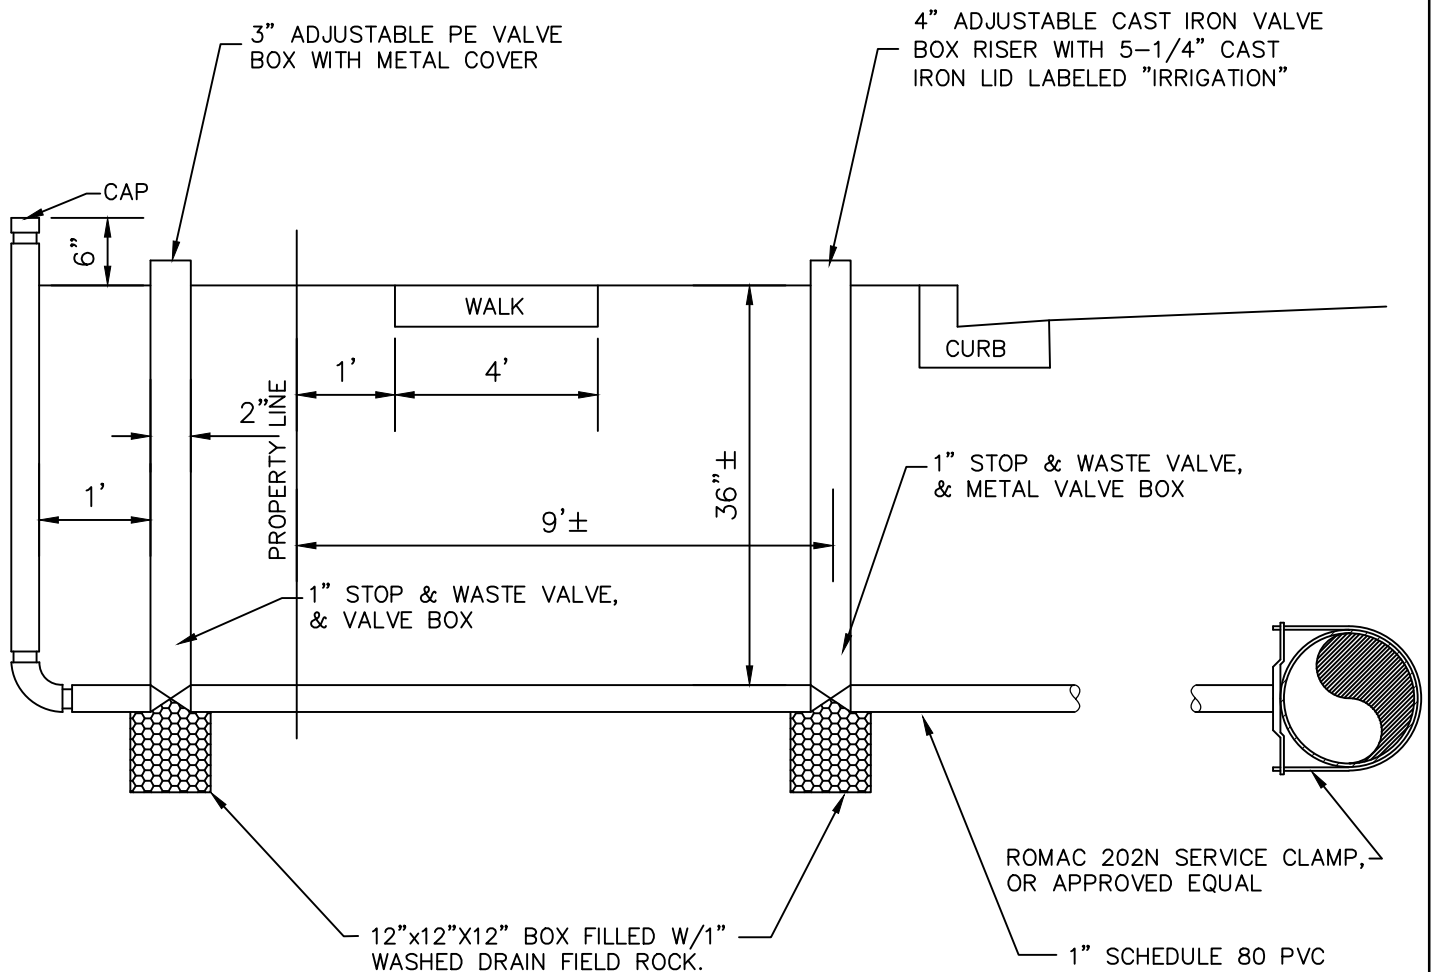

6-56


SECONDARY IRRIGATION SERVICE CONNECTION

REV. 04-19

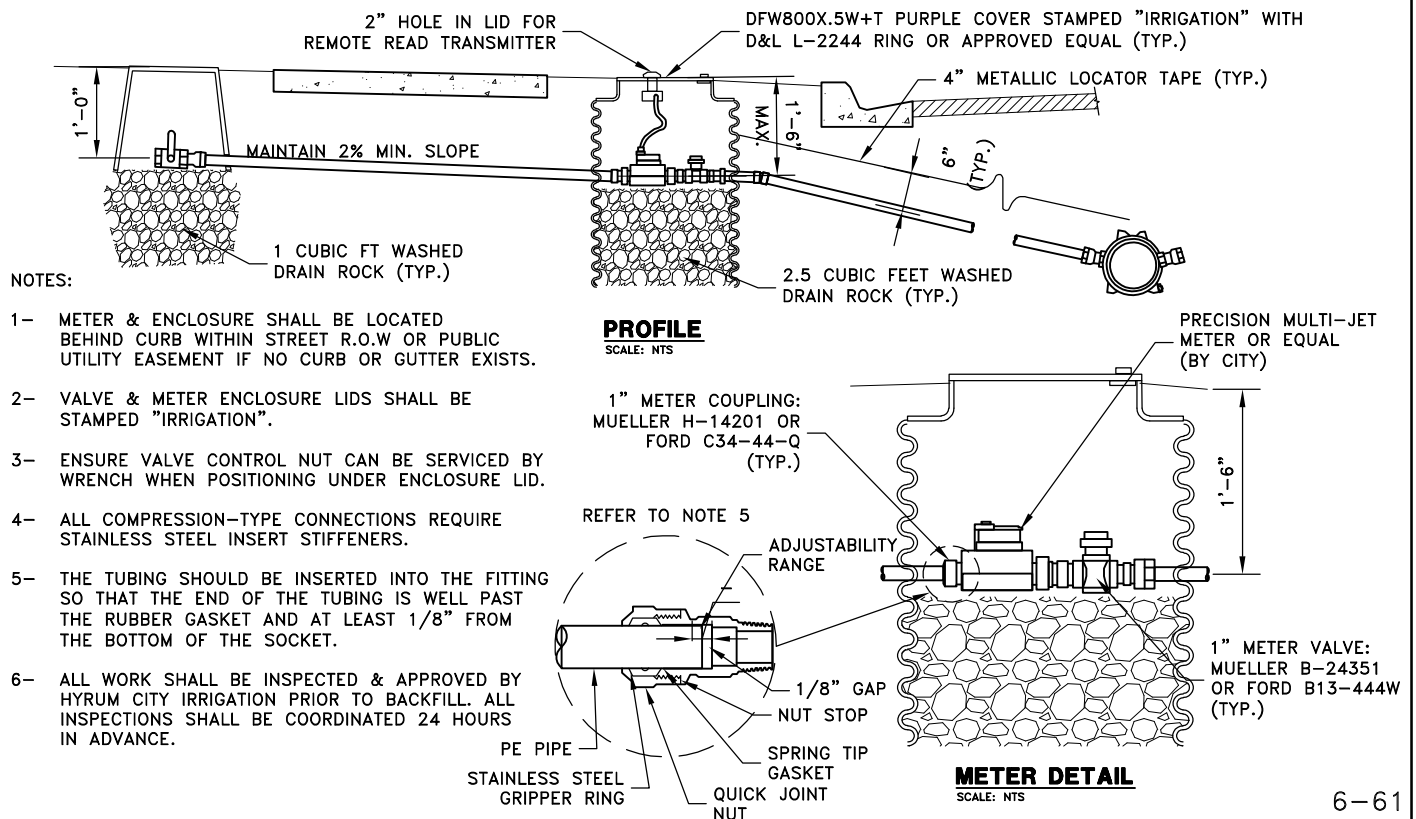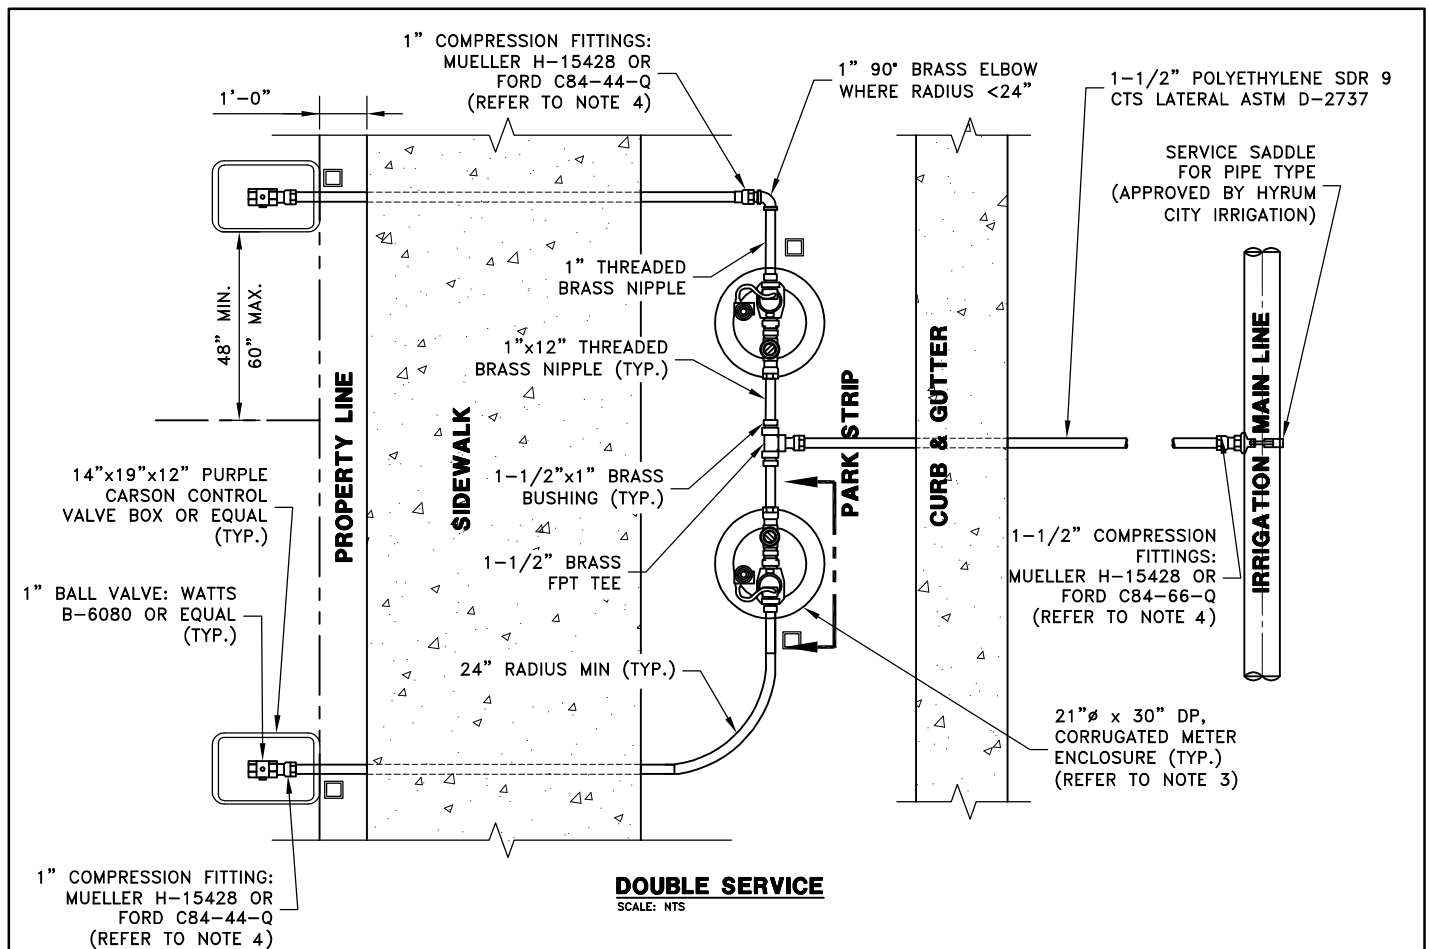

DOUBLE IRRIGATION SERVICE

REV. 09-13

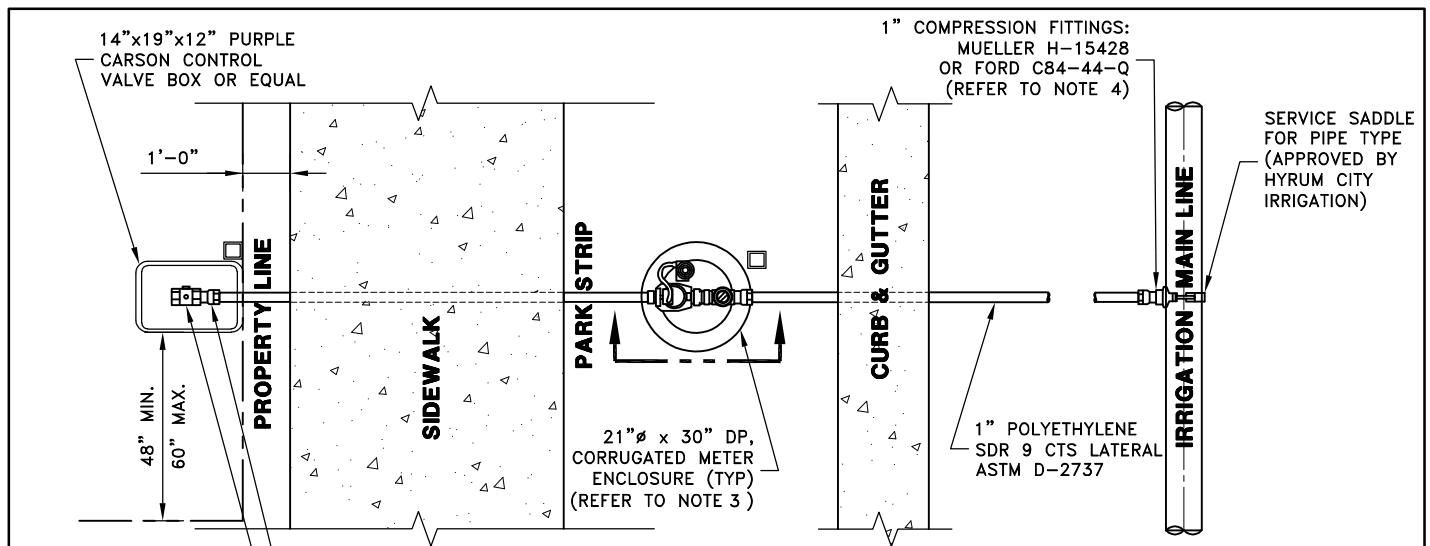


SINGLE SERVICE

SCALE: NTS

1" BALL VALVE: WATTS B-6080 OR EQUAL

1" COMPRESSION FITTING: MUELLER H-15428 OR FORD C84-44-Q (REFER TO NOTE 4)

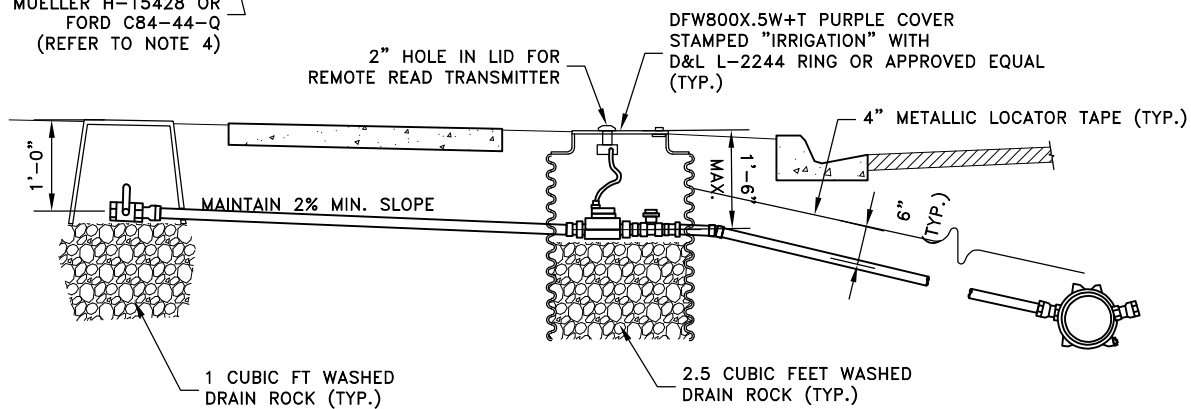


PROFILE

SCALE: NTS


NOTES:

- METER & ENCLOSURE SHALL BE LOCATED BEHIND CURB WITHIN STREET R.O.W OR PUBLIC UTILITY EASEMENT IF NO CURB OR GUTTER EXISTS.
- VALVE & METER ENCLOSURE LIDS SHALL BE STAMPED "IRRIGATION".
- ENSURE VALVE CONTROL NUT CAN BE SERVICED BY WRENCH WHEN POSITIONING UNDER ENCLOSURE LID.
- ALL COMPRESSION-TYPE CONNECTIONS REQUIRE STAINLESS STEEL INSERT STIFFENERS.
- THE TUBING SHOULD BE INSERTED INTO THE FITTING SO THAT THE END OF THE TUBING IS WELL PAST THE RUBBER GASKET AND AT LEAST 1/8" FROM THE BOTTOM OF THE SOCKET.
- ALL WORK SHALL BE INSPECTED & APPROVED BY HYRUM CITY IRRIGATION PRIOR TO BACKFILL. ALL INSPECTIONS SHALL BE COORDINATED 24 HOURS IN ADVANCE.

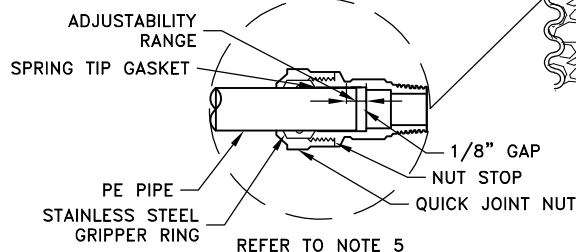

METER DETAIL

SCALE: NTS

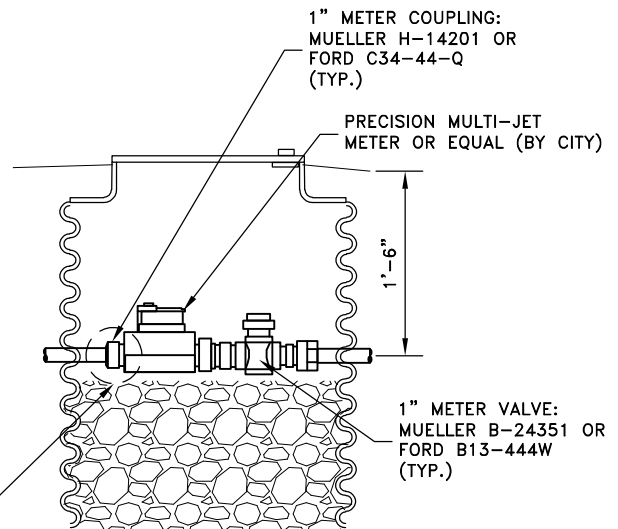

SINGLE IRRIGATION SERVICE